



3 4456 0550227 5

cy-1

CALCULATION OF ENERGY DEPOSITIONS AND DOSE RATES IN PROPOSED SHIELDING SURROUNDING THE TSR-II REACTOR

Shunsuke Uchida
Joe Lewin
R. E. Maerker


OAK RIDGE NATIONAL LABORATORY
CENTRAL RESEARCH LIBRARY
DOCUMENT COLLECTION

LIBRARY LOAN COPY

DO NOT TRANSFER TO ANOTHER PERSON

If you wish someone else to see this document, send in name with document and the library will arrange a loan.

UCR-FWB
43-5-471



OAK RIDGE NATIONAL LABORATORY
OPERATED BY UNION CARBIDE CORPORATION • FOR THE U.S. ATOMIC ENERGY COMMISSION

Printed in the United States of America. Available from
National Technical Information Service
U.S. Department of Commerce
5285 Port Royal Road, Springfield, Virginia 22151
Price: Printed Copy \$4.00; Microfiche \$0.95

This report was prepared as an account of work sponsored by the United States Government. Neither the United States nor the United States Atomic Energy Commission, nor any of their employees, nor any of their contractors, subcontractors, or their employees, makes any warranty, express or implied, or assumes any legal liability or responsibility for the accuracy, completeness or usefulness of any information, apparatus, product or process disclosed, or represents that its use would not infringe privately owned rights.

ORNL-TM-4450
UC-79d - Liquid Metal Fast
Breeder Reactors Physics

Contract No. W-7405-eng-26

Neutron Physics Division

CALCULATION OF ENERGY DEPOSITIONS AND DOSE RATES IN PROPOSED
SHIELDING SURROUNDING THE TSR-II REACTOR

*Shunsuke Uchida**

Joe Lewin R. E. Maerker

JANUARY 1974

* *On assignment from Hitachi Research Laboratory, Hitachi, Limited,
Hitachishi, Ibaraki-ken, JAPAN*

NOTICE This document contains information of a preliminary nature
and was prepared primarily for internal use at the Oak Ridge National
Laboratory. It is subject to revision or correction and therefore does
not represent a final report.

OAK RIDGE NATIONAL LABORATORY
Oak Ridge, Tennessee 37830
operated by
UNION CARBIDE CORPORATION
for the
U. S. ATOMIC ENERGY COMMISSION

OAK RIDGE NATIONAL LABORATORY LIBRARIES



3 4456 0550227 5

CONTENTS

| | Page |
|---|------|
| I. INTRODUCTION | 1 |
| II. CONFIGURATION OF THE TSR-II CORE AND OF THE SEVERAL PROPOSED SHIELDS | 2 |
| III. RESULTS OF THE CALCULATIONS. | 2 |
| IV. CONCLUSIONS | 19 |
| V. REFERENCES | 20 |
| VI. APPENDIX | 21 |

LIST OF FIGURES

| | Page |
|--|------|
| Fig. 1. Configuration Inside the Pressure Vessel of the TSR-II . | 4 |
| Fig. 2. Distribution of Fission Neutron Density. | 7 |
| Fig. 3. Energy Deposition in Steel (Case 1 and 2). | 13 |
| Fig. 4. Energy Deposition in Concrete (Case 1 and 2) | 14 |
| Fig. 5. Energy Deposition in Lead (Case 3) | 15 |
| Fig. 6. Dose Rate Distribution in Concrete (Case 1). | 16 |

LIST OF TABLES

| | Page |
|---|------|
| Table 1. Configurations Inside the Pressure Vessel of the TSR-II for a Spherical Model Calculation. | 3 |
| Table 2. Composition of Materials Used in the Calculation. | 5 |
| Table 3. Proposed Shielding Configurations Outside the Pressure Vessel of the TSR-II | 6 |
| Table 4. Neutron KERMA Factors for 21 Group Set. | 9 |
| Table 5. Gamma-Ray KERMA Factors for 18 Group Set. | 10 |
| Table 6. Energy Deposition in Concrete (Case 1). | 11 |
| Table 7. Energy Deposition in Stainless Steel (Case 1).. | 12 |
| Table 8. Energy Dependent Gamma-Ray Intensities of the Core of the TSR-II After Shut Down | 17 |
| Table 9. Dose Rate at Outer Surface of Shields under Operation and After Shutdown | 18 |

ABSTRACT

The spherical distributions of dose rates and energy depositions due to neutrons and gamma rays in several kinds of shields surrounding the TSR-II reactor are presented. The distributions were calculated using ANISN.

These results are used to determine an adequate configuration for the proposed new shielding around the TSR-II when an \sim 3-ft-diameter collimator is employed.

I. INTRODUCTION

A series of proposed beam shields for the TSR-II reactor¹ with a new large diameter beam hole (\sim 3 ft) has been investigated to determine heating and dose rate levels throughout the shields.

The ultimate shield must satisfy the following criteria:

1. Permissible gamma dose rate after shut down, both behind the shield and behind the beam shutter.
2. Permissible dose rate behind the shield while the reactor is operating to meet safety requirements at the 600-ft fence.
3. Permissible temperature rise in the shield under reactor operation.
4. Provide low background for measurements made in the beam hole behind relatively thick shields.
5. Low cost.

The calculations presented here investigate the first four criteria for several proposed shielding configurations.

II. CONFIGURATION OF THE TSR-II CORE AND OF THE SEVERAL PROPOSED SHIELDS

The configuration from the pressure vessel inward to the center of the core remains unaltered from the existing configuration. It is shown in Table 1 and Fig. 1 and the composition of the materials is shown in Table 2.

The configurations for the various proposed shields outside the reactor pressure vessel are shown in Table 3.

Cases 1 and 2 both consist of stainless steel-water multilayers and concrete. The only difference between them is the volume ratio of stainless steel and water in the multilayers.

Case 3 is the configuration at present used around the TSR-II.

Case 4 is a test configuration placed in front of the beam hole behind which measurements can reasonably be expected to be made. The dose rate behind this test shield should dominate those for cases 1-3.

Case 5 is a beam hole shutter shield, to be used after shut down.

Case 6 is the new proposed beam hole shutter, to be used after shut down.

III. RESULTS OF THE CALCULATIONS

Calculations with ANISN² were performed in spherical geometry using a 21 neutron - 18 gamma-ray group set expanded through P_3 .

The fission neutron distribution obtained from a core calculation is shown in Fig. 2, which is normalized to one fission neutron integrated over the core. In order to obtain the results at 1 MWt operation, a normalizing factor of 8.06×10^{16} n/sec/core has to be used. Details of calculating this normalizing factor are shown in Appendix A.

Table 1. Configurations Inside the Pressure Vessel of the
TSR-II for a Spherical Model Calculation

| Zone No. | Thickness (in.) | Compositions (Volume Ratio) | Remarks |
|----------|--------------------|---|-----------------|
| 1 | 5 1/2 | Aluminum (0.75), Water (0.23), Stainless Steel (0.02) | |
| 2 | 3/8 | Aluminum (0.170), Water (0.830) | |
| 3 | 1 | Aluminum (0.131), Water (0.394), Stainless Steel (0.0475), B ₄ C | Control Plate |
| 4 | 1 1/2 | Aluminum (0.354), Water (0.646) | |
| 5 | 1/8 | Aluminum (0.927), ²³⁵ U (3.257x10 ⁻⁴), ²³⁸ U (2.43x10 ⁻⁵) | Fuel Plate |
| 6 | 1/2 | Aluminum (0.165), Water (0.835) | |
| 7 | 5 1/2 | Aluminum (0.361), Water (0.635), ²³⁵ U (1.3038x10 ⁻⁴), ²³⁸ U (9.72x10 ⁻⁶) | Fuel |
| 8 | 1/4 | Aluminum (0.33), Water (0.67) | |
| 9 | 1/2 | Water (1.00) | |
| 10 | 3/4 | Aluminum (1.00) | |
| 11 | 2 | Water (1.00) | |
| 12 | 3/8 | Aluminum (1.00) | |
| 13 | 3/4 | Aluminum (1.00) | Pressure Vessel |

* ZONE NO. SHOWN IN TABLE 1

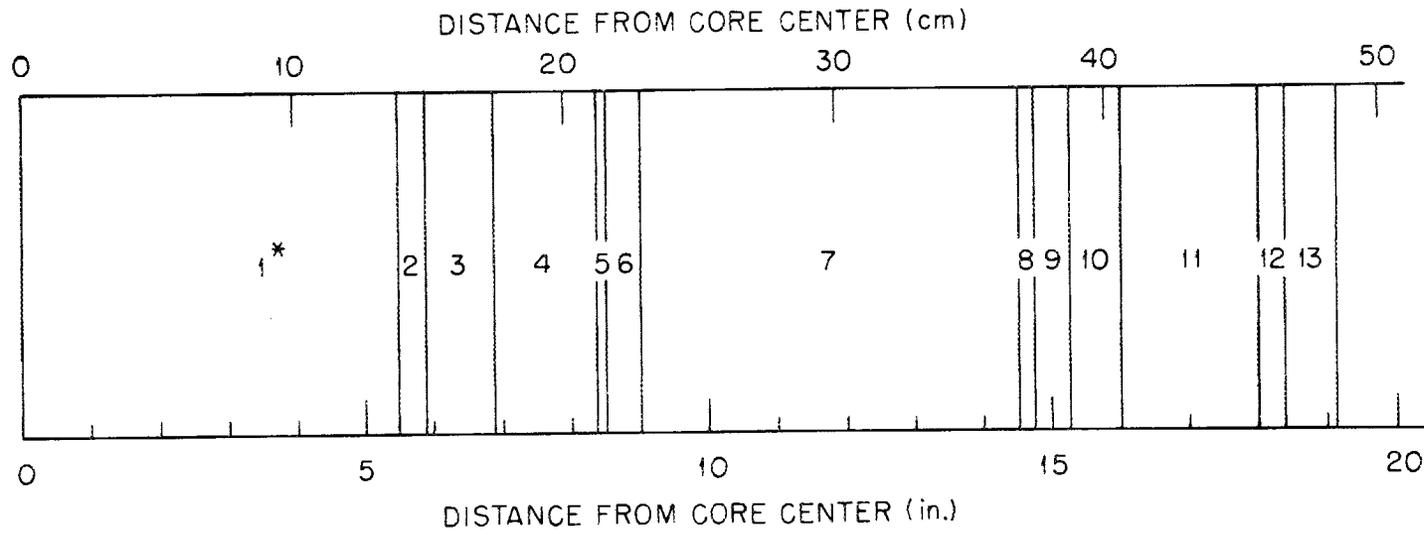


Fig. 1. Configuration Inside the Pressure Vessel of the TSR-II

Table 2. Composition of Materials Used in the Calculations

| Material (Density) | Composition | (Weight Percent) |
|--|-------------|------------------|
| Aluminum Alloy (2.767 g/cm ³) | Al | (98%) |
| | Mg, Fe, Si | (2%) |
| Stainless Steel 304 (7.88 g/cm ³) | Fe | (69.871%) |
| | Cr | (18.46%) |
| | Ni | (9.725%) |
| | Mn | (1.394%) |
| | Si, C, O | (9.55%) |
| Light Water (1.00 g/cm ³) | H | (11.2%) |
| | O | (88.8%) |
| Concrete (2.31 g/cm ³) | H | (0.4%) |
| | C | (10.4%) |
| | O | (48.9%) |
| | Si | (2.3%) |
| | Ca | (38.0%) |

Table 3. Proposed Shielding Configurations Outside the Pressure Vessel of the TSR-II

| Case No. | Zone No. | Thickness (in.) | Compositions (Volume Ratio) |
|----------|----------|--------------------|--------------------------------------|
| 1 | 14 | 1 | Stainless Steel (1.0) |
| | 15 | 8 | Stainless Steel (0.65), Water (0.35) |
| | 16 | 1 | Stainless Steel (1.0) |
| | 17 | 66 | Concrete |
| 2 | 14 | 1 | Stainless Steel (1.0) |
| | 15 | 8 | Stainless Steel (0.35), Water (0.65) |
| | 16 | 1 | Stainless Steel (1.0) |
| | 17 | 66 | Concrete |
| 3 | 14 | 17 1/8 | Lead (0.5), Water (0.5) |
| | 15 | 31 1/4 | Water |
| 4* | 14 | 12 | Steel |
| | 15 | 120 | Sodium |
| 5** | 14 | 10 | Lead |
| 6*** | 14 | 1/2 | Stainless Steel |
| | 15 | 11 | Lead |
| | 16 | 1/2 | Stainless Steel |

*Configuration to be considered as minimum test of a foreground measurement.

**Configuration of shutter for the beam hole.

***Proposed configuration of shutter for the new beam hole.

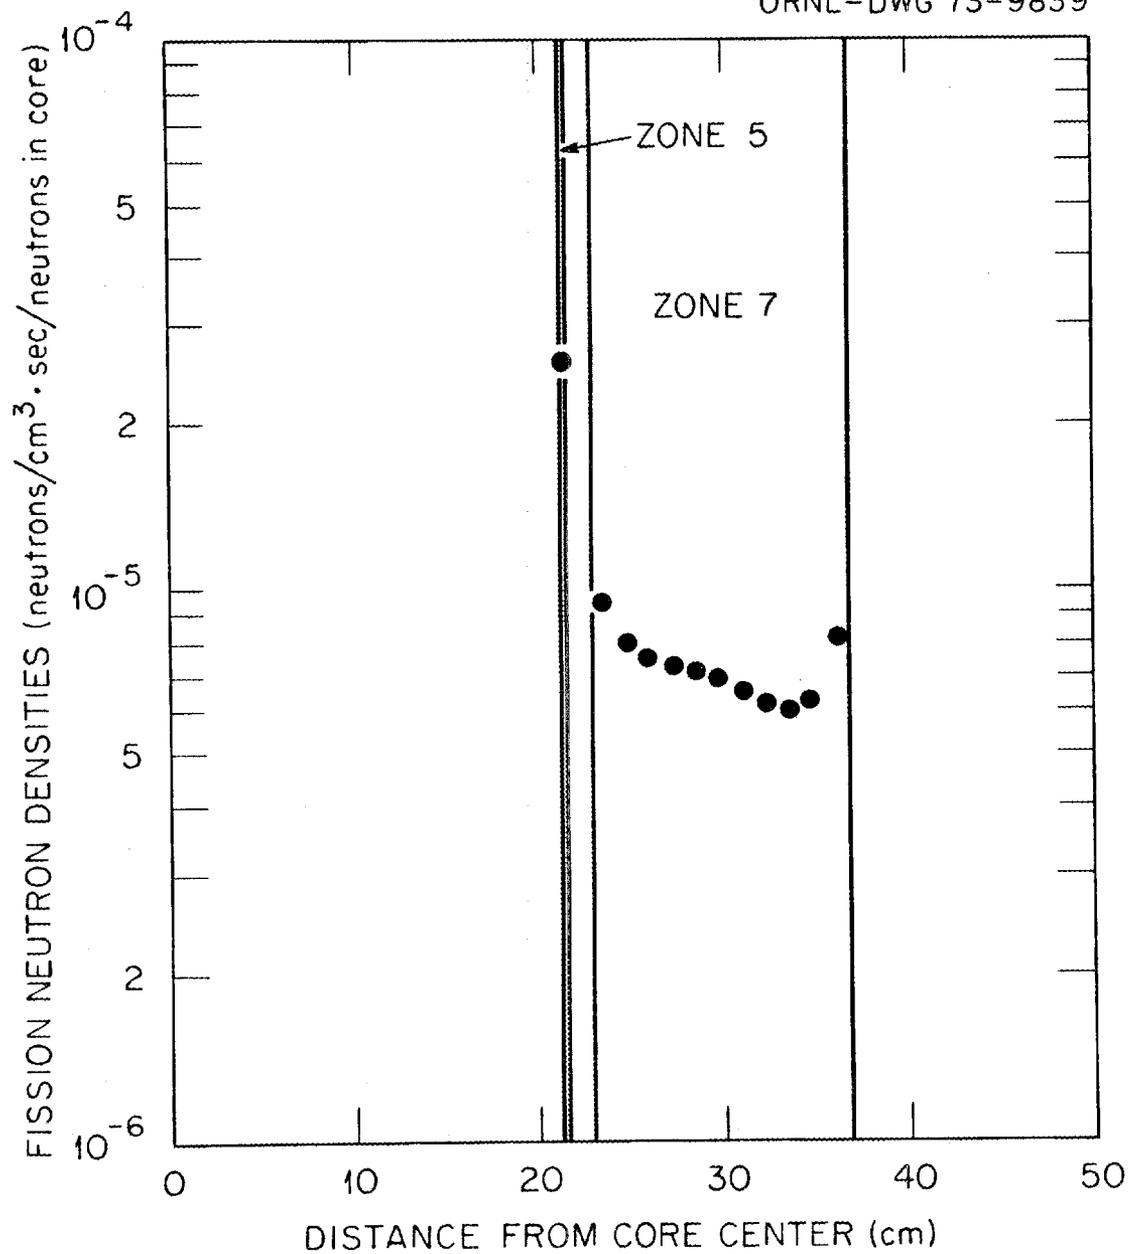


Fig. 2. Distribution of Fission Neutron Density

3.1. Heat Generation in the Shields

For the first three cases, energy deposition in the shield materials due to neutrons and gamma rays with the reactor operating were calculated by using a 39 group KERMA factor.³ The 39 group KERMA factors for concrete, steel, and lead are shown in Tables 4 and 5. The calculated results are shown in Tables 6 and 7 for case 1 and in Figs. 3, 4, and 5. Since the energy deposition due to gamma rays is dominant in each case, the contribution of the neutrons can be neglected in calculating the heating rates in the shields.

3.2. Dose Rate Under Operation

The dose rate distribution in concrete for Case 1 is shown in Fig. 6. The dose rate at the outer surface of each shield for cases 1-4 is shown in Table 9.

3.3. Shut Down Dose Rate

To obtain the shut down fission product gamma-ray dose rate, intensities of the gamma rays after shut down were calculated using ORIGEN code⁷ for the conditions following an operation of four cycles of 8 hr up and 16 hr down and then 8 hr up, the power during the up cycle being 1 MWt. Intensities of these source gamma rays are shown in Table 8.

The dose rate distribution for each case is calculated by assuming a flat source distribution in the core with the spectrum as shown in the table.

The results are shown in Table 9.

Table 4. Neutron KERMA Factors for 21 Group Set
(erg/cm/n)

| Energy Group | Upper Energy (eV) | Concrete ⁴ | Steel ⁵ | Lead ⁵ |
|--------------|------------------------|-----------------------|--------------------|-------------------|
| 1 | 1.4918(7) ^a | 2.69(-7) | 3.40(-7) | 1.24(-8) |
| 2 | 1.0000(7) | 1.52(-7) | 1.34(-7) | 9.80(-9) |
| 3 | 6.7032(6) | 1.10(-7) | 5.84(-8) | 8.06(-9) |
| 4 | 4.4933(6) | 1.11(-7) | 3.54(-8) | 7.58(-9) |
| 5 | 3.0119(6) | 6.67(-8) | 2.51(-8) | 5.84(-9) |
| 6 | 2.0190(6) | 6.08(-8) | 1.71(-8) | 3.53(-9) |
| 7 | 1.3534(6) | 6.63(-8) | 1.09(-8) | 2.36(-9) |
| 8 | 9.0718(5) | 3.77(-8) | 7.90(-9) | 1.79(-9) |
| 9 | 5.5023(5) | 3.75(-8) | 6.93(-9) | 1.19(-9) |
| 10 | 3.3323(5) | 2.17(-8) | 3.26(-9) | 1.07(-9) |
| 11 | 2.0242(5) | 1.43(-8) | 2.81(-9) | 7.27(-10) |
| 12 | 1.2277(5) | 7.75(-9) | 1.50(-9) | 4.20(-10) |
| 13 | 4.0867(4) | 2.85(-9) | 1.71(-9) | 1.48(-10) |
| 14 | 1.1709(4) | 8.85(-10) | 2.74(-10) | 6.95(-11) |
| 15 | 3.3546(3) | 2.35(-10) | 7.43(-11) | 4.50(-11) |
| 16 | 7.4852(2) | 5.27(-11) | 2.10(-11) | 4.13(-11) |
| 17 | 1.6702(2) | 1.19(-11) | 8.36(-12) | 4.41(-11) |
| 18 | 3.7266(1) | 2.80(-12) | 8.88(-12) | 4.90(-11) |
| 19 | 8.3153(0) | 9.22(-13) | 1.61(-11) | 8.22(-11) |
| 20 | 1.8554(0) | 8.36(-13) | 3.50(-11) | 1.75(-10) |
| 21 | 4.1339(-1) | 2.25(-12) | 1.17(-11) | 5.84(-10) |

^aRead as: 1.4919 x 10⁷.

Table 5. Gamma-Ray KERMA Factors for 18 Group Set⁶
(MeV/cm/γ)

| Energy Group | Upper Energy (eV) | Concrete | Steel | Lead |
|--------------|----------------------|----------|----------|----------|
| 1 | 1.00(7) ^a | 3.68(-1) | 1.60(0) | 4.00(0) |
| 2 | 8.00(6) | 3.10(-1) | 1.29(0) | 3.07(0) |
| 3 | 7.00(6) | 2.74(-1) | 1.10(0) | 2.51(0) |
| 4 | 6.00(6) | 2.37(-1) | 9.11(-1) | 1.99(0) |
| 5 | 5.00(6) | 2.01(-1) | 7.34(-1) | 1.51(0) |
| 6 | 4.00(6) | 1.74(-1) | 6.10(-1) | 1.19(0) |
| 7 | 3.50(6) | 1.56(-1) | 5.31(-1) | 9.90(-1) |
| 8 | 3.00(6) | 1.38(-1) | 4.55(-1) | 8.11(-1) |
| 9 | 2.50(6) | 1.1 (-1) | 3. (-1) | 6.64(-1) |
| 10 | 2.00(6) | 1.01(-1) | 3.20(-1) | 5.56(-1) |
| 11 | 1.60(6) | 8.33(-2) | 2.62(-1) | 4.83(-1) |
| 12 | 1.20(6) | 6.62(-2) | 2. (-1) | 4. (-1) |
| 13 | 9.00(5) | 4.90(-2) | 1.58(-1) | 4.70(-1) |
| 14 | 6.00(5) | 3.40(-2) | 1.13(-1) | 5.90(-1) |
| 15 | 4.00(5) | 1.83(-2) | 7.43(-2) | 1.13(0) |
| 16 | 2.10(5) | 1.16(-2) | 9.19(-2) | 2.88(0) |
| 17 | 1.20(5) | 1.49(-2) | 2.21(-1) | 3.84(0) |
| 18 | 7.00(4) | 3.13(-2) | 4.96(0) | 1.11(1) |

^aRead as: 1.00 x 10⁷.

Table 6. Energy Deposition in Concrete (Case 1)

| Radius of Mesh Point* (cm) | Energy Deposition in Concrete (W/cm ³ /MWt) | |
|-------------------------------|--|-----------------|
| | Due to Gamma Rays | Due to Neutrons |
| 76.52 | 2.04(-4) ^a | 2.34(-5) |
| 81.60 | 1.40(-4) | 1.24(-5) |
| 86.68 | 1.00(-4) | 6.80(-6) |
| 91.76 | 7.35(-5) | 3.76(-6) |
| 96.84 | 5.41(-5) | 2.14(-6) |
| 101.92 | 3.93(-5) | 1.23(-6) |
| 107.00 | 2.84(-5) | 7.23(-7) |
| 112.08 | 2.03(-5) | 4.30(-7) |
| 117.16 | 1.44(-5) | 2.60(-7) |
| 122.24 | 1.01(-5) | 1.58(-7) |
| 127.32 | 7.05(-6) | 9.67(-8) |
| 132.40 | 4.86(-6) | 6.03(-8) |
| 137.48 | 3.56(-6) | 3.15(-8) |
| 142.56 | 2.30(-6) | 2.34(-8) |
| 147.64 | 1.58(-6) | 1.47(-8) |
| 152.72 | 1.08(-6) | 9.27(-9) |
| 157.80 | 7.39(-7) | 2.58(-9) |
| 162.88 | 5.06(-7) | 3.72(-9) |
| 167.96 | 3.46(-7) | 2.36(-9) |
| 173.04 | 2.38(-7) | 1.51(-9) |
| 178.12 | 1.62(-7) | 9.59(-10) |
| 183.20 | 1.11(-7) | 6.15(-10) |
| 188.28 | 7.67(-8) | 3.91(-10) |
| 193.36 | 5.28(-8) | 2.51(-10) |
| 198.44 | 3.87(-8) | 1.61(-10) |
| 203.52 | 2.53(-8) | 1.04(-10) |
| 208.60 | 1.75(-8) | 6.69(-11) |
| 213.68 | 1.22(-8) | 4.30(-11) |
| 218.76 | 8.47(-9) | 2.77(-11) |
| 223.84 | 5.89(-9) | 1.17(-11) |
| 228.92 | 4.09(-9) | 1.12(-11) |
| 234.00 | 2.82(-9) | 6.96(-12) |
| 239.08 | 1.98(-9) | 3.67(-12) |

*Inner and Outer Radii of Concrete Shield are 73.98 cm and 241.62 cm, respectively.

^aRead: 2.04 x 10⁻⁴.

Table 7. Energy Deposition in Stainless Steel (Case 1)

| Radius of Mesh Point (cm) | Energy Deposition in Steel (W/cm ³ /Mwt) | |
|------------------------------|---|-----------------|
| | Due to Gamma Rays | Due to Neutrons |
| 49.00* | 2.05(-1) | 6.34(-4) |
| 49.85* | 1.43(-1) | 5.46(-4) |
| 50.69* | 1.07(-1) | 4.63(-4) |
| 52.04** | 7.55(-2) | 3.55(-4) |
| 53.89** | 4.99(-2) | 2.45(-4) |
| 55.74** | 3.34(-2) | 1.72(-4) |
| 57.85** | 2.31(-2) | 1.22(-4) |
| 59.43** | 1.61(-2) | 8.62(-5) |
| 61.28** | 1.13(-2) | 6.13(-5) |
| 63.12** | 8.10(-3) | 4.38(-5) |
| 64.97** | 5.80(-3) | 3.13(-5) |
| 66.82** | 4.18(-3) | 2.26(-5) |
| 68.67** | 3.00(-3) | 1.64(-5) |
| 70.51** | 2.14(-3) | 1.25(-5) |
| 71.86*** | 1.59(-3) | 1.06(-5) |
| 72.71*** | 1.29(-3) | 9.59(-6) |
| 73.55*** | 1.07(-3) | 8.54(-6) |

*1-in. stainless steel inner and outer radii of which are 48.58 cm and 51.12 cm, respectively.

**8-in. stainless steel and water mixture, inner and outer radii of which are 51.12 cm and 71.44 cm, respectively. Volume ratio of stainless steel is 65%.

***1-in. stainless steel, inner and outer radii of which are 71.44 cm and 73.98 cm, respectively.

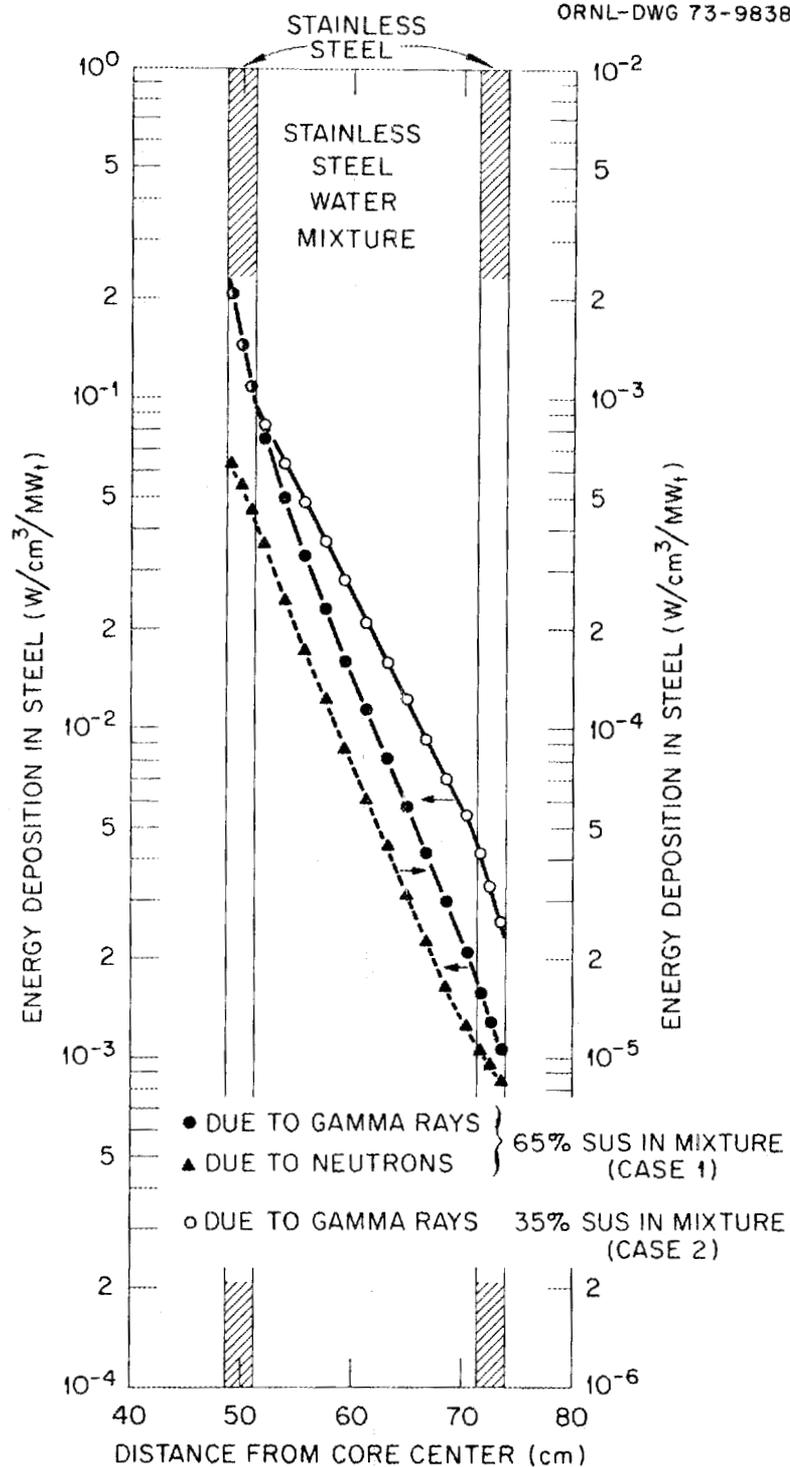


Fig. 3. Energy Deposition in Steel (Case 1 and 2)

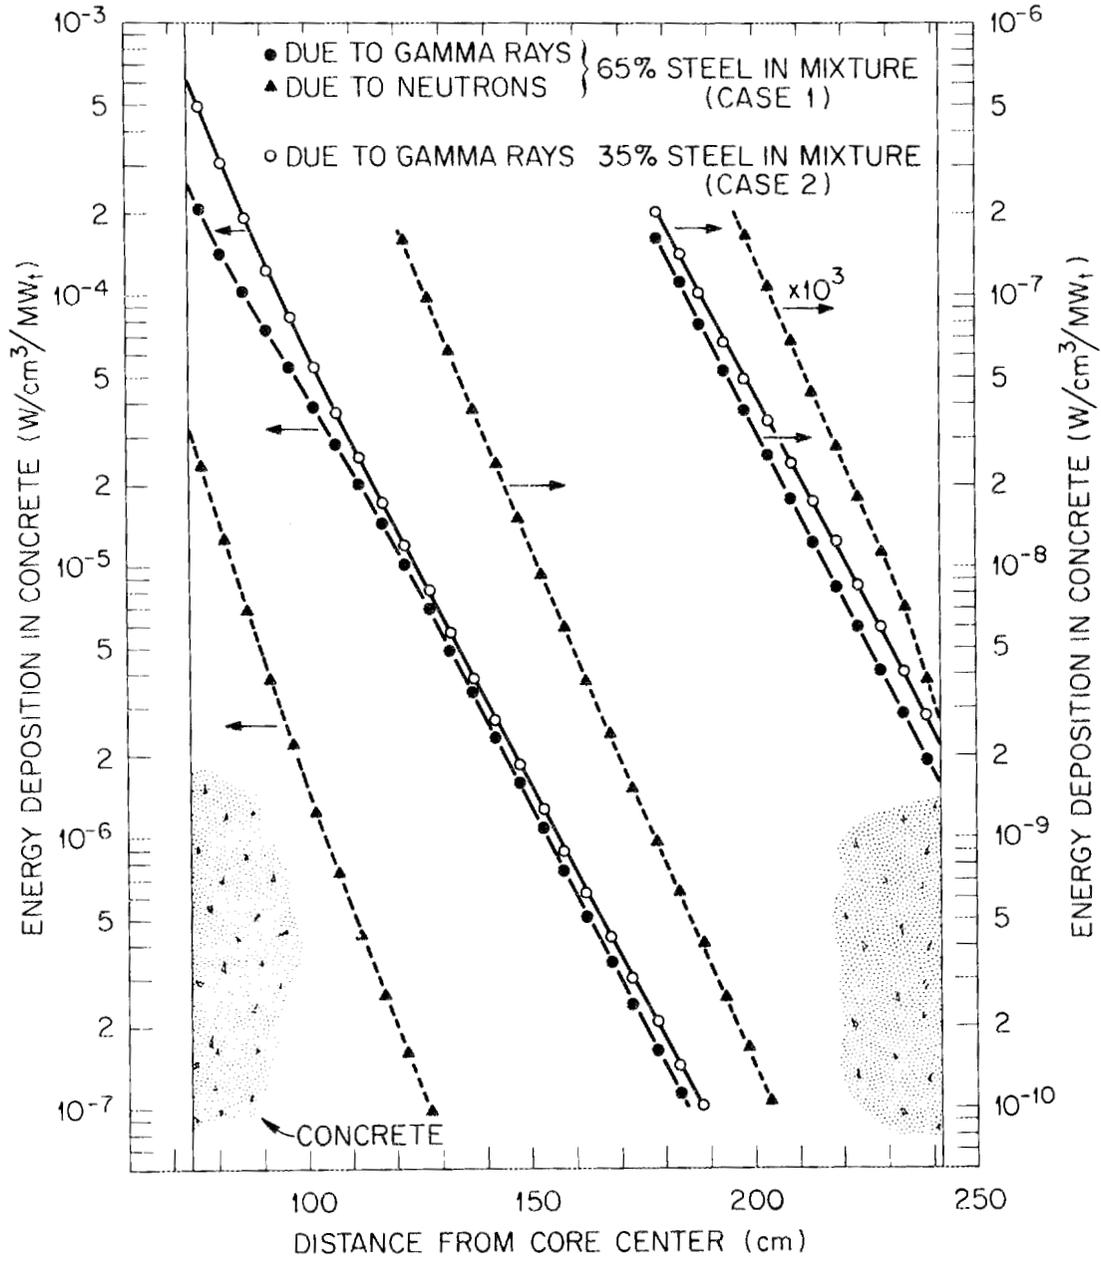


Fig. 4. Energy Deposition in Concrete (Case 1 and 2)

ORNL-DWG 73-9836


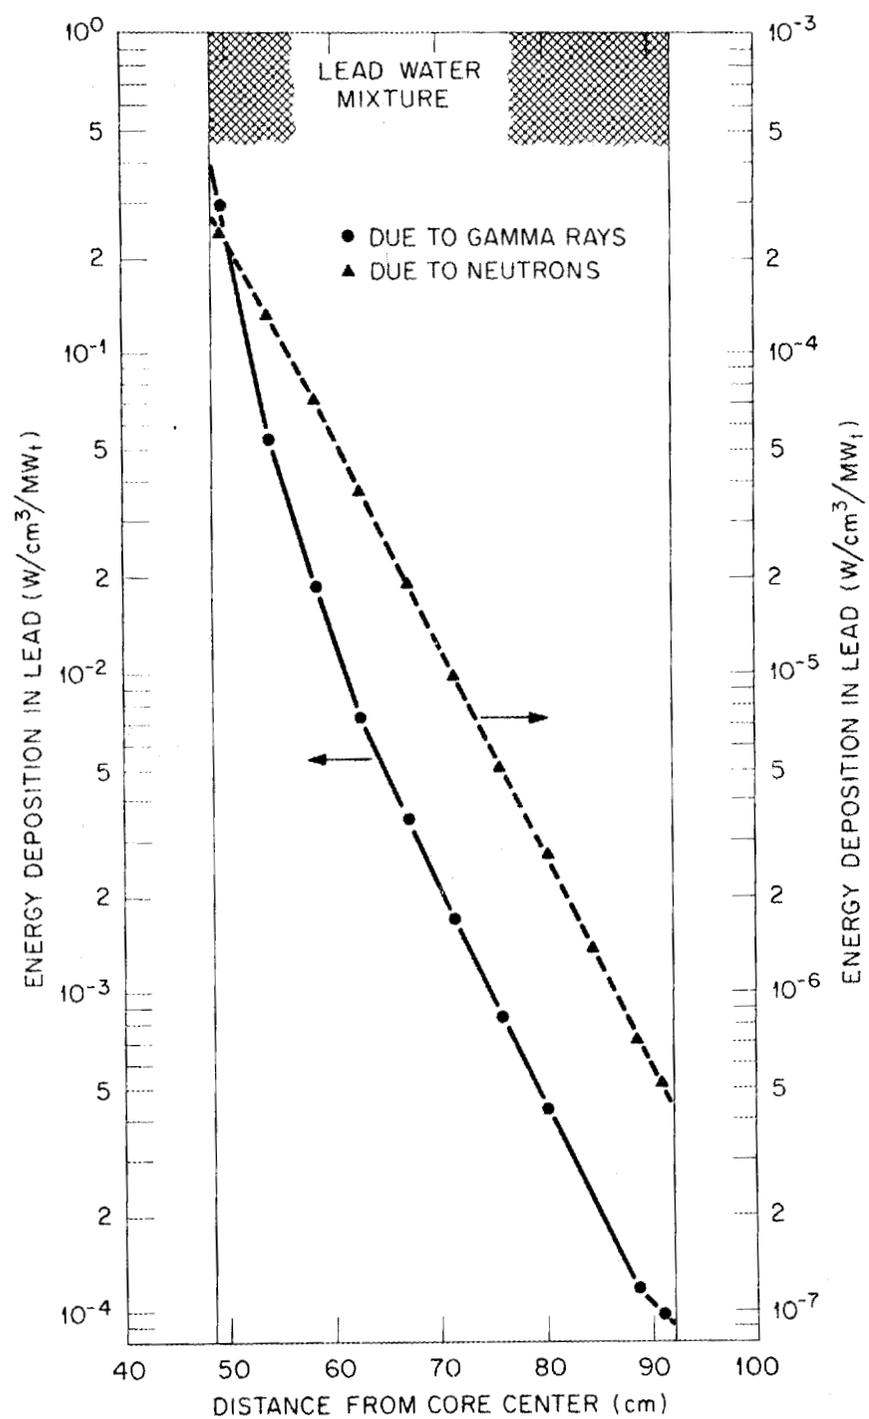


Fig. 5. Energy Deposition in Lead (Case 3)

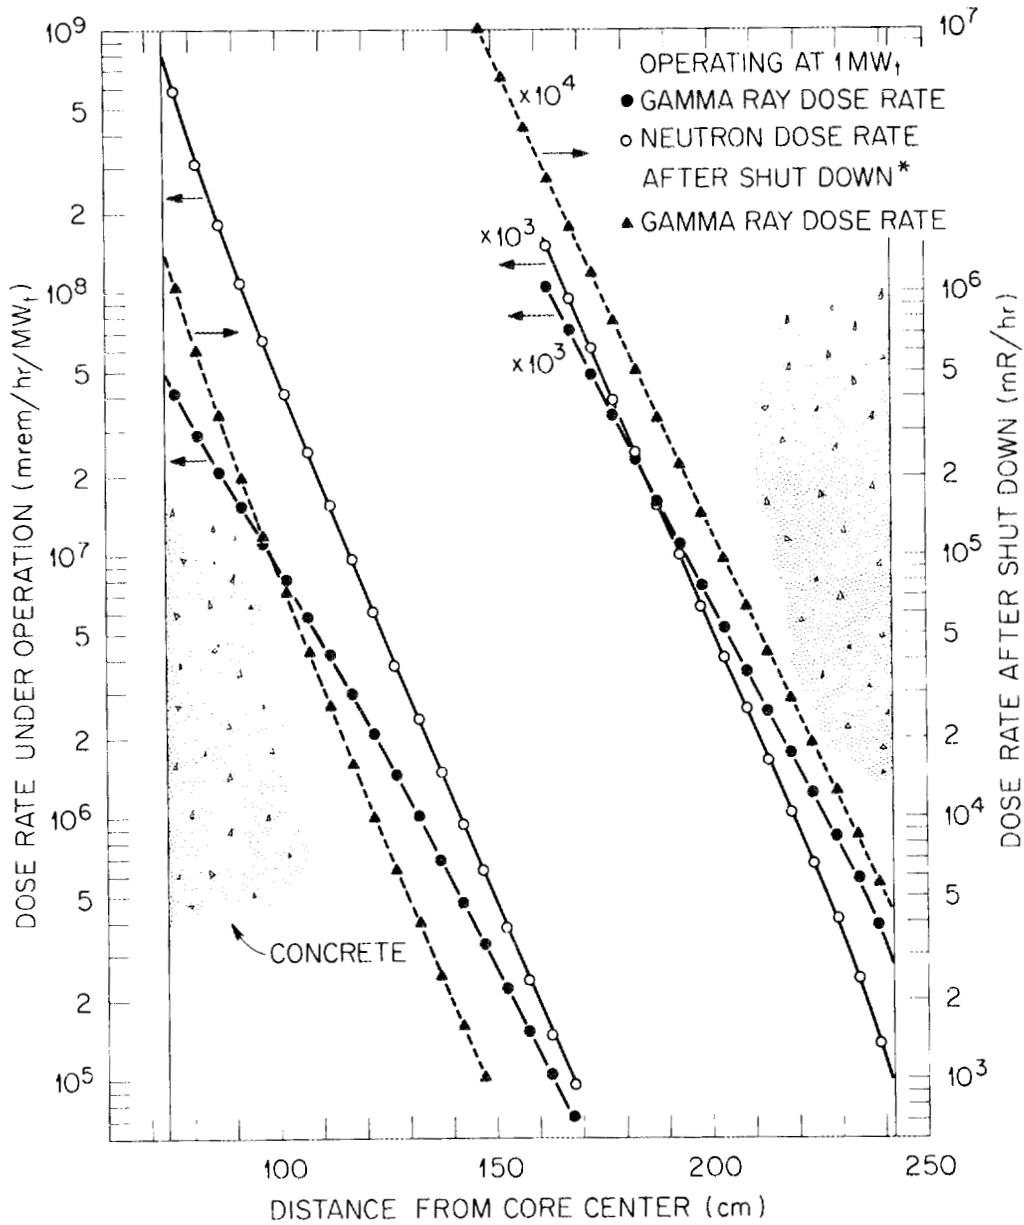

* JUST AFTER 8 hr OF OPERATION FOLLOWING 4 CYCLES OF 8 hr UP AND 16 hr DOWN. POWER = 1.0 MW_t

Fig. 6. Dose Rate Distribution in Concrete (Case 1)

Table 8. Energy Dependent Gamma Ray Intensities from the Core of the TSR-II after Shut Down*

| Energy Range (MeV) | Intensities (γ/sec) |
|-----------------------|-------------------------------------|
| 10.0-8.0 | 0 |
| 8.0-7.0 | 0 |
| 7.0-6.0 | 0 |
| 6.0-5.0 | 6.17(13) ^a |
| 5.0-4.0 | 8.06(14) |
| 4.0-3.5 | 1.76(14) |
| 3.5-3.0 | 1.05(15) |
| 3.0-2.5 | 2.17(15) |
| 2.5-2.0 | 3.27(15) |
| 2.0-1.6 | 6.73(15) |
| 1.6-1.2 | 1.41(16) |
| 1.2-0.9 | 1.42(16) |
| 0.9-0.6 | 2.45(16) |
| 0.6-0.4 | 1.63(16) |
| 0.4-0.21 | 2.41(16) |
| 0.21-0.12 | 1.26(15) |
| 0.12-0.07 | 0 |
| 0.07-0.0 | 0 |

*Calculated conditions: After 8 hr of operation following 4 cycles of 8 hr up and 16 hr down. Power = 1.0 Mwt.

^aRead: 6.17×10^{13} .

Table 9. Dose Rate at Outer Surface of Shields under Operation and after Shut Down

| Case No. | Under Operation | | After Shutdown |
|-----------------|--------------------------|----------------------------|----------------------------|
| | Neutrons (mrem/h/MWt) | Gamma Rays (mrem/h/MWt) | Gamma Rays (mrem/h/MWt) |
| 1 | 5.5×10^1 | 3.09×10^2 | 4.20×10^{-1} |
| 2 | 7.59×10^1 | 4.72×10^2 | 1.65×10 |
| 3 | 8.83×10^2 | 3.64×10^4 | 2.11×10^1 |
| 4 | 2.76×10^5 | 1.06×10^5 | |
| 5* | | | 5.79×10^2 |
| 6* | | | 8.48×10^1 |
| Modified Case** | 5.0×10^2 | 1.00×10^3 | 1.58×10 |

* Shutters for beam hole.

** Same as case 1 but 5.0 feet concrete instead of 5.5 feet.

IV. CONCLUSIONS

The results shown in Figs. 3-5 (i.e., cases 1-3), when applied to a calculation of the temperature distribution in the shields, show that no serious temperature gradients or heating problems result.⁸

Under operation, the dose rates behind the shield for cases 1, 2, and Modified 1 (see Table 9) are all lower than the existing case 3, which has already met safety requirements at the fence.

Comparing these dose rates with those of case 4 shows that background should be no problem.

The gamma-ray dose rate after shut down (see Table 9) is seen to be dominated by the shutters (cases 5 or 6), and not by the shields (case 1-3, Modified 1). Since the dose rate behind the proposed shutter (case 6) is 85 mr/hr, personnel must wait a few minutes after shut down before venturing near the beam hole.

As a result of these calculations, and considering construction costs, the Modified case 1 shown in Table 9 has been proposed to be the shield built. It consists of 1 in. stainless steel, 8 in. stainless steel-water mixture containing 65% by volume stainless steel, 1 in. stainless steel, and 5 ft of ordinary concrete. The proposed beam hole shutter consists of 1/2 in. stainless steel, 11 in. lead, and 1/2 in. stainless steel.

V. REFERENCES

1. L. B. Holland and C. E. Clifford, "Description of the Tower Shielding Reactor II and Proposed Preliminary Experiments," ORNL-2747 (1959).
2. W. W. Engle, Jr., "A User's Manual for ANISN, A One-Dimensional Discrete Ordinates Transport Code with Anisotropic Scattering," USAEC Report K-1692 (1967).
3. Oak Ridge National Laboratory and Computing Technology Center Union Carbide Corporation Nuclear Division, "RITTS, 121 Group Coupled Neutron and Gamma-Ray Cross-Section Data for Transport Codes," USAEC Report DLC-11.
4. F. R. Mynatt, private communication.
5. R. W. Roussin, private communication.
6. J. R. Knight and F. R. Mynatt, "MUG, A Program for Generating Multi-group Photon Cross Sections," USAEC Report CTC-17 (1970).
7. C. W. Kee, private communication.
8. G. H. Llewellyn, private communication.

VI. APPENDIX

A. Normalizing Factor

Reactor Power: $P = 1.0 \text{ MWt}$

Average neutrons per fission: $\bar{\nu} = 2.45 \text{ n/fission}$

Conversion factor from watt to fission rate: $C = 3.29 \times 10^{10}$
fission/sec/watt

Normalizing factor: $f = P.C.\bar{\nu} = 8.06 \times 10^{16} \text{ n/sec/MWt}$

ORNL-TM-4450
 UC-79d - Liquid Metal Fast
 Breeder Reactors Physics

INTERNAL DISTRIBUTION

- | | | | |
|--------|----------------------|--------|-----------------------------|
| 1-3. | L. S. Abbott | 28. | P. N. Stevens |
| 4. | D. E. Bartine | 29. | D. B. Trauger |
| 5. | R. L. Childs | 30. | D. K. Trubey |
| 6-10. | C. E. Clifford | 31-36. | S. Uchida |
| 11. | W. W. Engle, Jr. | 37. | G. E. Whitesides |
| 12. | G. F. Flanagan | 38. | A. Zucker |
| 13. | R. M. Freestone, Jr. | 39. | H. Feshbach (consultant) |
| 14. | W. O. Harms | 40. | P. F. Fox (consultant) |
| 15. | K. M. Henry | 41. | C. R. Mehl (consultant) |
| 16. | L. B. Holland | 42. | H. T. Motz (consultant) |
| 17. | J. Lewin | 43-44. | Central Research Library |
| 18. | R. E. Maerker | 45. | ORNL Y-12 Technical Library |
| 19. | F. C. Maienschein | | Document Reference Section |
| 20. | F. J. Muckenthaler | 46-48. | Laboratory Records |
| 21-26. | F. R. Mynatt | 49. | Laboratory Records ORNL RC |
| 27. | E. M. Oblow | 50. | ORNL Patent Office |

EXTERNAL DISTRIBUTION

- 51-52. USAEC Division of Reactor Research and Technology, Washington, D. C. 20545: Director.
53. USAEC-RRD Senior Site Representative, Oak Ridge National Laboratory, P. O. Box Oak Ridge, TN 37830
54. USAEC Oak Ridge Operations Office, P. O. Box E, Oak Ridge, TN: Research and Technical Support Division.
- 55-282. For distribution as shown in TID-4500 Distribution Category, UC-79d, Liquid Metal Fast Breeder Reactors Physics.