



3 4456 0443891 8



ORNL/ER-408

**ENVIRONMENTAL
RESTORATION
PROGRAM**

**Final Deactivation Report
on the Radioisotope Production Lab-C,
Building 3030,
at Oak Ridge National Laboratory,
Oak Ridge, Tennessee**

OAK RIDGE NATIONAL LABORATORY
CENTRAL RESEARCH LIBRARY
CIRCULATION SECTION
4500N ROOM 175

LIBRARY LOAN COPY

DO NOT TRANSFER TO ANOTHER PERSON.
if you wish someone else to see this report, send in
name with report and the library will arrange a loan.

ORNL-118 (6-97)

This document has been approved by the
ORNL Technical Information Office
for release to the public. Date: 8/13/97

MANAGED BY
LOCKHEED MARTIN ENERGY SYSTEMS, INC.
FOR THE UNITED STATES
DEPARTMENT OF ENERGY

ENERGY SYSTEMS



ORNL/ER-408

**Final Deactivation Report
on the Radioisotope Production Lab-C,
Building 3030,
at Oak Ridge National Laboratory,
Oak Ridge, Tennessee**

Date Issued—August 1997


Prepared for the
U.S. Department of Energy
Office of Environmental Management
under budget and reporting code EW 20

Environmental Management Activities at the
OAK RIDGE NATIONAL LABORATORY
Oak Ridge, Tennessee 37831
managed by
LOCKHEED MARTIN ENERGY SYSTEMS, INC.
for the
U.S. DEPARTMENT OF ENERGY
under contract DE-AC05-84OR21400

LOCKHEED MARTIN ENERGY RESEARCH LIBRARIES




3 4456 0443891 8

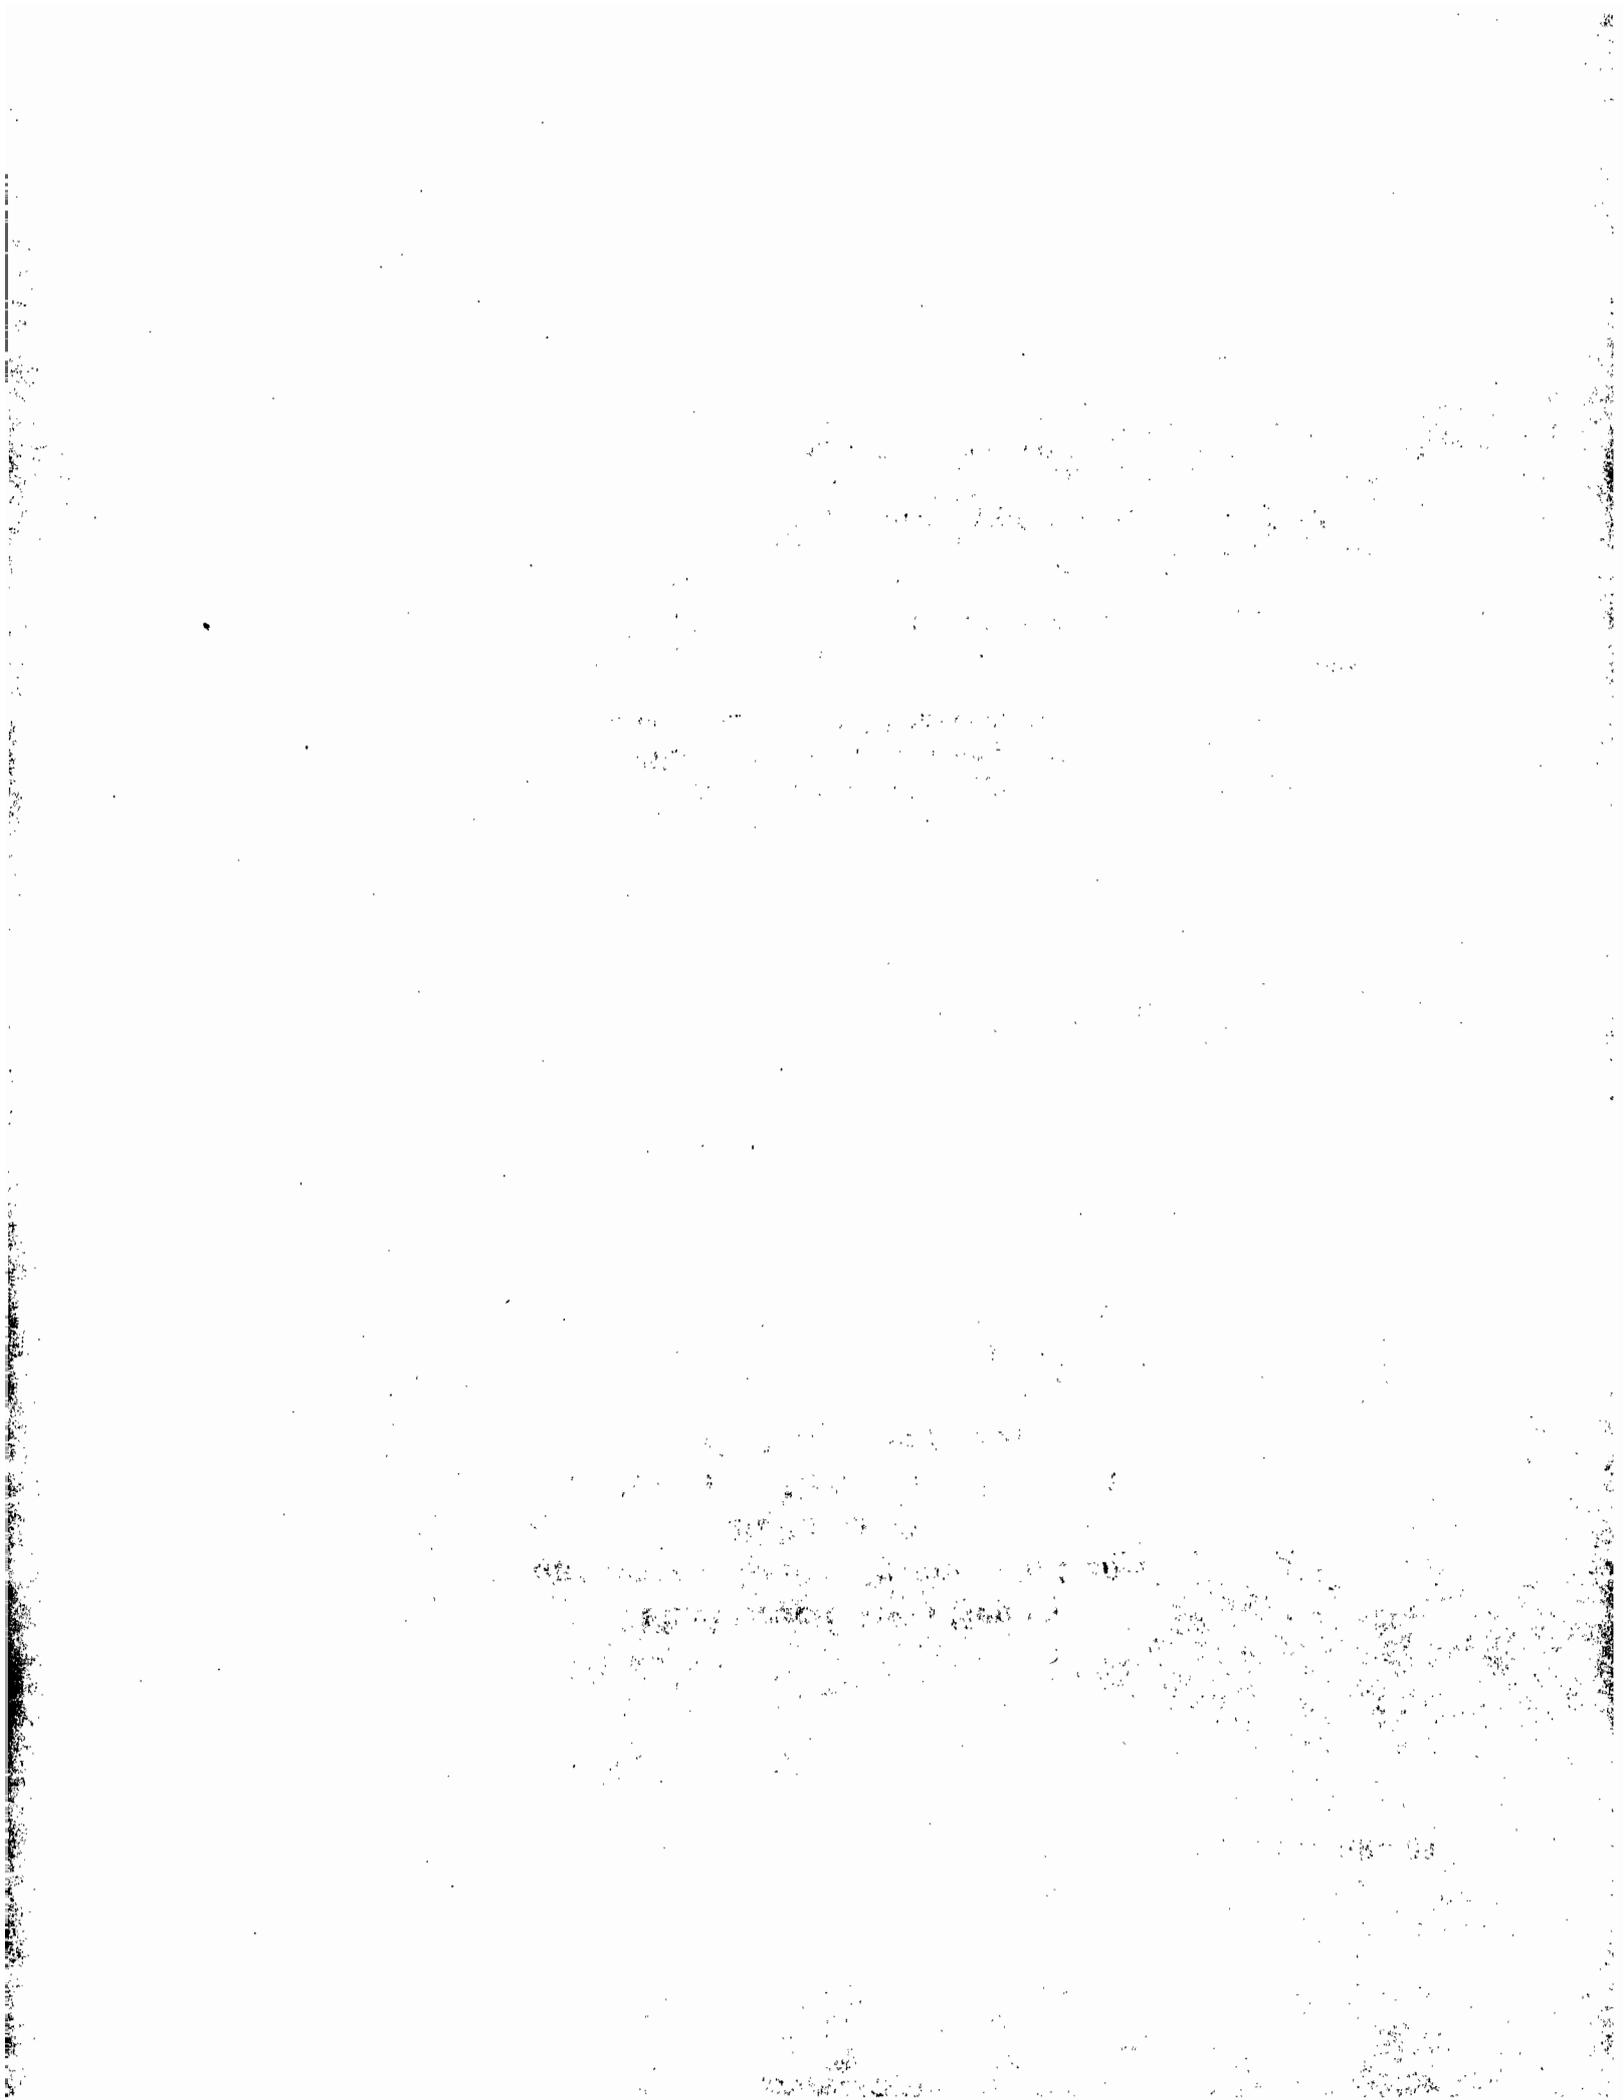

PREFACE

This is the *Final Deactivation Project Report on the Radioisotope Production Lab-C, Building 3030, at Oak Ridge National Laboratory, Oak Ridge, Tennessee* (ORNL/ER-408). Although this element of work is not part of the Comprehensive Environmental Response, Compensation, and Liability Act of 1980, it was accomplished in accordance with the substantive requirements of the Act. This work was performed under Work Breakdown Structure 1.6.6.2.10.02, Activity Data Sheet 6504IS, "Isotopes Facilities Deactivation Project." This document provides the Environmental Management and Enrichment Facilities Program with the final report on the deactivation of Bldg. 3030.

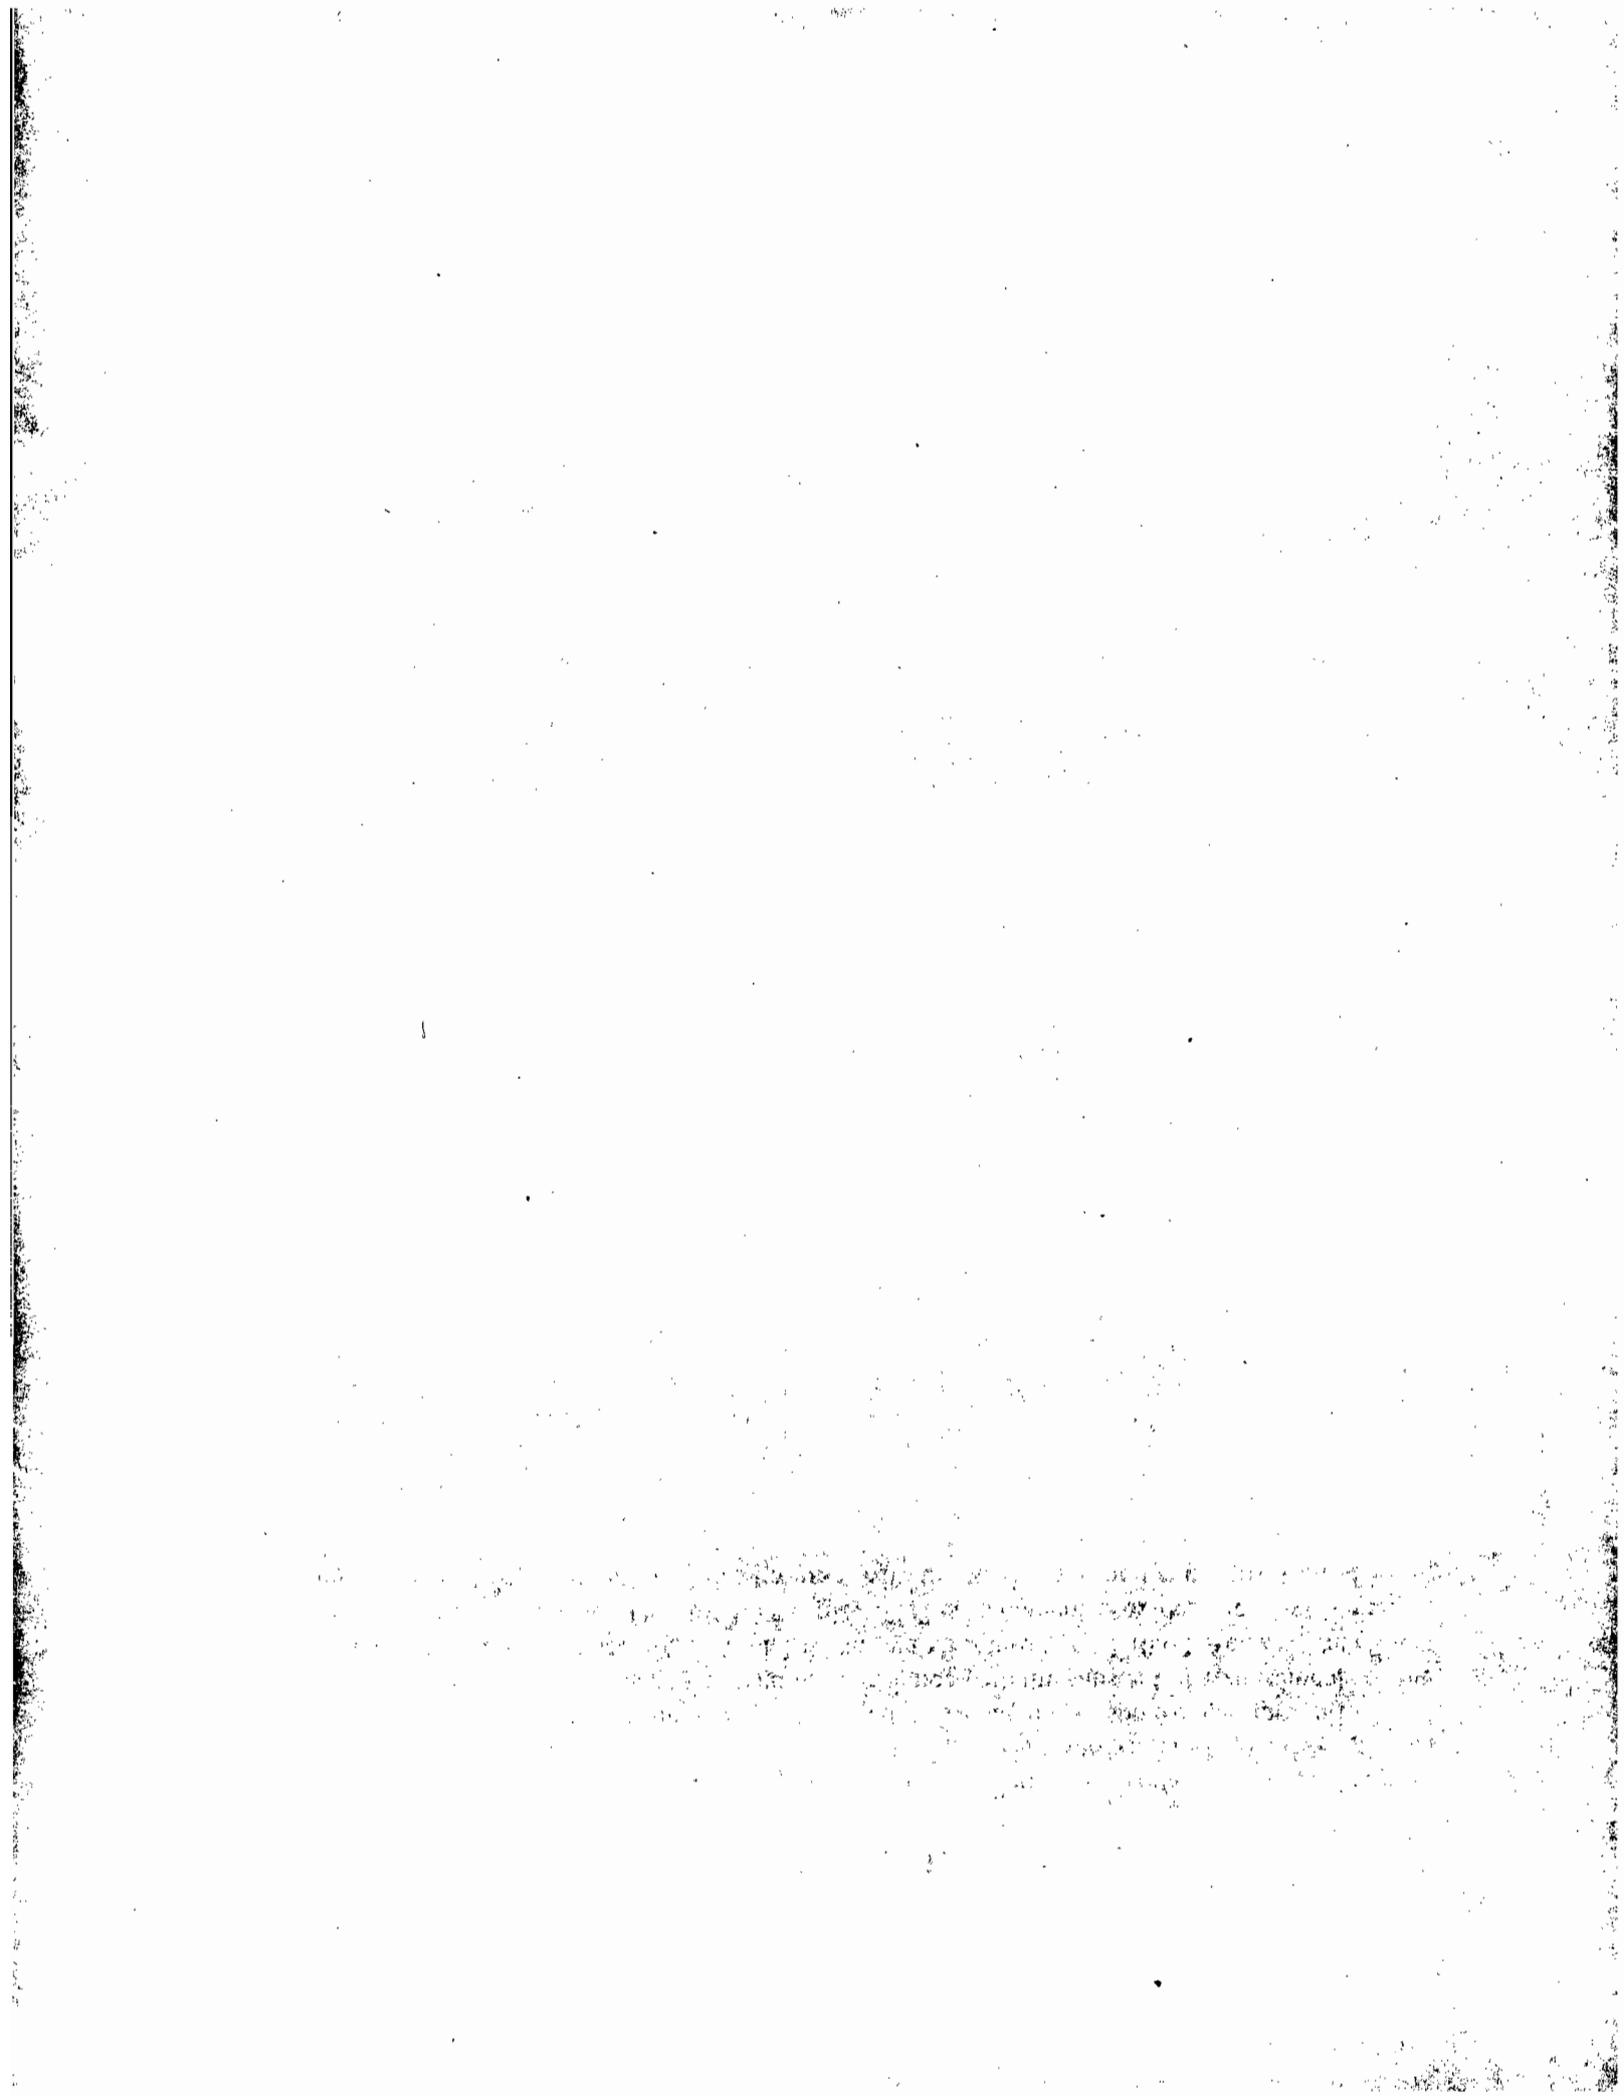

CONTENTS

PREFACE	iii
TABLES	ix
ABBREVIATIONS	xi
DEFINITIONS	xiii
EXECUTIVE SUMMARY	xv
1. INTRODUCTION	1
1.1 PURPOSE	1
1.2 SCOPE	1
2. BACKGROUND	1
2.1 FACILITY DESCRIPTION	1
2.2 FACILITY HISTORY	2
3. FACILITY STATUS	2
3.1 PREDEACTIVATION FACILITY STATUS	2
3.1.1 Hazards Analysis	2
3.1.2 Internal Spaces	2
3.1.3 Building Structure and External Spaces	2
3.1.4 Process, Utility, and Support Systems	3
3.1.5 Radioactive Material, Contamination, and Waste	4
3.1.6 Hazardous Materials and Waste	5
3.2 POST DEACTIVATION FACILITY STATUS	5
3.2.1 Deactivation End Point Completion	6
3.2.2 Hazards Analysis	6
3.2.3 Internal Spaces	6
3.2.4 Building Structure and External Spaces	6
3.2.5 Process, Utility, and Support Systems	6
3.2.6 Radioactive Material, Contamination, and Waste	8
3.2.7 Hazardous Materials and Waste	8
4. BLDG. 3030 DEACTIVATION ACTIVITIES	9
4.1 INTERNAL SPACES; ACCESS REQUIRED	9
4.1.1 General Areas	9
4.2 INTERNAL SPACES; NO ACCESS REQUIRED	9
4.2.1 Bldg. 3030 Hot Cell	9
4.3 EXTERNAL SPACES	10
4.3.1 Bldg. 3030 Structure	10
4.3.2 Bldg. 3030 Roof	10

4.4	OPERATIONAL SYSTEMS	10
4.4.1	Electrical Power System	10
4.4.2	Fire Protection System	10
4.4.3	Hot Drain System	10
4.4.4	Process Drain System	10
4.4.5	Central Ventilation System	10
4.4.6	Local Ventilation System	10
4.5	“MOTHBALLED” SYSTEMS	11
4.6	ABANDONED SYSTEMS	11
4.6.1	Building Steam System	11
4.6.2	Potable Water System	11
4.6.3	Hot Cell Manipulator	11
4.6.4	Natural Gas System	11
4.6.5	Overhead Crane	11
4.6.6	Plant Air System	11
5.	TRANSITION ACTIVITIES	11
5.1	MEMORANDUM OF AGREEMENT	11
5.2	POST-TRANSITION ACTIVITIES	12
6.	POSTDEACTIVATION S&M	12
7.	ABNORMAL ACTIVITIES/CONDITIONS	12
8.	TURNOVER PACKAGE DOCUMENTATION	13
8.1	ADMINISTRATIVE TURNOVER PACKAGE	13
8.1.1	Final Deactivation Project Report	13
8.1.2	Regulatory Compliance Documentation	13
8.1.3	Interagency Agreements Documentation	13
8.1.4	Existing Permit Documentation	13
8.1.5	Corrective Action Documentation	13
8.1.6	Deactivation Locks and Keys	14
8.2	TECHNICAL TURNOVER PACKAGE	14
8.2.1	Updated Facility Drawings (Arrangements, PID, Loop, Etc.)	14
8.2.2	“As Left” Photos of Spaces and Major Equipment	14
8.2.3	Hazardous Materials Inventory and Survey	14
8.2.4	Safeguards and Security Documentation	15
8.2.5	Chemical Substance Inventory and Survey	15
8.2.6	Radioactive Materials Inventory and Survey	15
8.2.7	Facility Soil, Surface Water, and Groundwater Condition Report	15
8.3	S&M TURNOVER PACKAGE	15
8.3.1	Postdeactivation S&M Plan	15
8.3.2	Postdeactivation S&M Updated Safety Equipment List	15
8.3.3	Postdeactivation S&M Procedures	16
9.	ASSOCIATED LITERATURE	16
10.	ATTACHMENTS	16

ATTACHMENT 1 BLDG. 3030 FLOOR PLAN 1-1

ATTACHMENT 2 BLDG. 3030 PREDEACTIVATION FACILITY PHOTOGRAPHS 2-1

ATTACHMENT 3 BLDG. 3030 POSTDEACTIVATION FACILITY PHOTOGRAPHS ... 3-1

ATTACHMENT 4 ADMINISTRATIVE TURNOVER PACKAGE CHECKLIST 4-1

ATTACHMENT 5 TECHNICAL TURNOVER PACKAGE CHECKLIST 5-1

ATTACHMENT 6 BLDG. 3030 DRAWING LIST 6-1

ATTACHMENT 7 BLDG. 3030 RADIOLOGICAL SURVEY DATA 7-1

ATTACHMENT 8 S&M TURNOVER PACKAGE CHECKLIST 8-1

TABLES

1. Predeactivation Radioactive Contamination Levels	5
2. Predeactivation Radiation Levels	5
3. Bldg. 3030 Predeactivation Hazardous Materials and Waste	5
4. Postdeactivation Radioactive Contamination Levels	8
5. Postdeactivation Radiation Levels	8
6. Bldg. 3030 Postdeactivation Hazardous Materials and Waste	8
7. Bldg. 3030 Updated Drawings	14
8. Bldg. 3030 S&M Procedures	16

ABBREVIATIONS

D&D	Decontamination and Decommissioning
DOE	U.S. Department of Energy
EM-40	Department of Energy Office of Environmental Restoration
EM-60	Department of Energy Office of Facility Transition and Management
FDPR	Final Deactivation Project Report
MOA	Memorandum of Agreement
ORNL	Oak Ridge National Laboratory
S&M	Surveillance and Maintenance

DEFINITIONS

Commitments	Tasks required to be accomplished to meet non-regulatory requirements. (site, stakeholders, etc.)
Deactivation	The process of placing a facility in a safe and stable condition to minimize the long-term cost of a surveillance and maintenance program that is protective of workers, the public, and the environment until decommissioning is completed.
Decommissioning	Refers to the ultimate disposition of a facility. Also substitutes for previously used "D&D."
Decontamination	The removal or reduction of radioactive or hazardous contamination from facilities, equipment, or soils by washing, heating, chemical or electro-chemical action, mechanical cleaning or other techniques to achieve a stated objective or end condition.
Defense-in-Depth	Achieving required levels of safety and protection there is more than one layer of protection between the hazard and that which is being protected.
End Point	A detailed specification for the final deactivation condition of areas and hardware within a facility and related documentation. An individual milestone towards the deactivation and/or the decommissioning of a facility.
End Point Technical Information	A compilation of documents to support end point conclusions.
Stakeholder	Individuals and organizations (i.e. regulators, local municipalities, the public, etc.) who may be directly or indirectly impacted by activities associated with the IFDP.
Turnover Package	A compilation of project related documents to be given to a postdeactivation organization.

EXECUTIVE SUMMARY

The purpose of this report is to document the condition of Bldg. 3030 after completion of deactivation activities as outlined by the Department of Energy (DOE) Office of Nuclear Materials and Facility Stabilization Program (EM-60) guidance documentation. This report outlines the activities conducted to place the facility in a safe and environmentally sound condition for transfer to DOE's Office of Environmental Restoration Program (EM-40).

This report provides profile of Bldg. 3030 before and after deactivation activities. Turnover items, such as the Postdeactivation Surveillance & Maintenance Plan, remaining hazardous materials, radiological controls, Safeguards and Security, QA, facility operations, and supporting documentation provided in the Office of Nuclear Materials and Facility Stabilization Program (EM-60) Turnover package are discussed.

Building 3030 will require access to facilitate required S&M activities to maintain the building safety envelope. Building 3030 was stabilized during deactivation so that when transferred to the EM-40 program, only a minimal S&M effort would be required to maintain the building's safety envelope. Other than the minimal S&M activities, the building will be unoccupied and the exterior doors locked to prevent unauthorized access. The building will be entered only for required S&M.

All materials have been removed from the building and the hot cell, and all utility systems, piping, and alarms have been deactivated.

1. INTRODUCTION

1.1 PURPOSE

This report documents the condition of Bldg. 3030 after completion of deactivation activities as outlined by the Department of Energy (DOE) Office of Nuclear Materials and Facility Stabilization (EM-60) Program guidance documentation. This report outlines the activities conducted to place the facility in a safe and environmentally sound condition for transfer to the DOE Office of Environmental Restoration (EM-40) Program.

This report provides a profile of the facility before and after deactivation activities. Turnover items, such as the Postdeactivation Surveillance & Maintenance Plan, remaining hazardous materials, radiological controls, Safeguards and Security, QA, facility operations, and supporting documentation provided in the EM-60 Turnover package are discussed.

1.2 SCOPE

This report addresses the activities performed during deactivation associated with Bldg. 3030, to place the facility in a safe and environmentally sound condition to await decommissioning, the status of the facility, and the activities required to maintain the facility following deactivation. Attachment 1, "Building 3030 Floor Plan," provides a floor plan of Bldg. 3030 that illustrates the physical boundaries and scope of this Final Deactivation Project Report (FDPR). The scope of this FDPR is limited to Bldg. 3030.

2. BACKGROUND

2.1 FACILITY DESCRIPTION

Building 3030 is a steel-frame structure covered by corrugated aluminum siding. The single-story facility has a floor area of 825 ft². A manipulator-type hot cell is located on the middle of the east wall. Two laboratory-type hoods occupy the northeast corner of the building with one laboratory-type hood occupying the center of the north wall of the building. A laboratory-type workbench occupies the center of the facility and is equipped with a sink. The manipulator cell and laboratory hoods constitute the primary means of containment. All high-level work was conducted in the hot cell. The building operates at a slightly negative pressure relative to the outside atmosphere.

The hot cell has 2-ft barytes concrete walls with 4 in. of lead brick shielding on the operating face of the cell wall and an unshielded top cover. The cell has a mineral-oil-filled, lead glass window. A stainless steel operating pan covers the floor and interior walls up to the level of the viewing window. A small steel door on the north side of the cell is used for the insertion and removal of small equipment and containers. A thick steel double door at the back of the cell provides access for larger items if needed.

Extended reach Model-8 manipulators are inserted through holes in the top of the cell. The slave sections of the manipulators are covered with urethane manipulator boots sealed to the inside top surfaces of the cells. An additional plastic boot and wiper seals in the manipulator barrels provide secondary containment for manipulator penetration.

2.2 FACILITY HISTORY

Building 3030 was constructed in 1950 as part of the Isotopes Program. The building contains facilities that were used for storage purification and processing and dispensing of a wide variety of radioisotopes. These isotopes were processed primarily from irradiated targets from the High Flux Isotope Reactor, the Oak Ridge Research Reactor, and the 86-in. Cyclotron.

3. FACILITY STATUS

3.1 PREDEACTIVATION FACILITY STATUS

Following approximately 40 years of operations and processing, Bldg. 3030 was surplus, and many of the process systems were abandoned in place. General housekeeping was not maintained, and the building structural integrity was allowed to lapse.

Attachment 2, "Predeactivation Facility Photographs," contains photographs of the building conditions prior to deactivation activities.

3.1.1 Hazards Analysis

No predeactivation hazards analysis was performed. Since only process activities involving less than 100 ci were performed in Bldg. 3030, it was determined that the facility did not warrant a hazard analysis or safety analysis.

3.1.2 Internal Spaces

The general area contained furniture, cabinets, hazardous waste, radioactive waste, and miscellaneous items used when the facility was in operation. The lead-based paint is chipping and peeling, providing a means of transferring lead and endangering personnel and the environment.

Predeactivation radioactive contamination levels and radiation levels for the general area are listed in Tables 1 and 2, respectively. Table 3 lists predeactivation hazardous materials and waste located in the general area.

3.1.3 Building Structure and External Spaces

The structure and roof of Bldg. 3030 were inspected and found to be in generally good condition, with the exception of water inleakage through various paths.

3.1.4 Process, Utility, and Support Systems

3.1.4.1 Electrical power system

Prior to deactivation, the electrical power system provided power distribution for the electrical service to Bldg. 3030. Typical electrical loads were the lighting, heaters, and exhaust fans. A 480-VAC outlet also existed for use with welders and other equipment requiring this service.

3.1.4.2 Fire protection system

The fire protection system is a dry pipe fire suppression system for Bldg. 3030 and is available for use. The general area was equipped with sprinkler heads and alarms as required by the local fire code. In addition, fire extinguishers were placed strategically in and around Bldg. 3030.

The fire protection system is not believed to be contaminated.

3.1.4.3 Building steam system

The building steam system provided steam for use in heating the general area of Bldg. 3030. Two heat exchangers located in Bldg. 3030 provided space heating for personnel.

The building steam system is not believed to be contaminated. However, most of the steam piping within Bldg. 3030 is lagged with asbestos insulation materials.

3.1.4.4 Potable water system

Prior to deactivation, the potable water system provided water to the Bldg. 3030 safety shower, water heater, and sink. The potable water system is not believed to be contaminated.

3.1.4.5 Hot drain system

Prior to deactivation, the hot drain system provided a means of discharging liquid process wastes from the hot cells to the LLLW system. The hot drain system is a gravity drain system to the WC-10 tank in the low-level liquid waste (LLLW) system.

The hot drain system was determined to be highly contaminated from the process and cleaning activities performed prior to deactivation.

3.1.4.6 Process drain system

Prior to deactivation, the process drain system provided a means of removing liquids from the area floor to the ORNL process waste system and treatment facility. The process drain system is a gravity drain system.

The process drain system was determined to be contaminated from the process and cleaning activities performed prior to deactivation.

3.1.4.7 Natural gas system

The natural gas system to Bldg. 3030 was never used. The system has remained isolated from the building since the time of its installation and is not believed to be contaminated.

3.1.4.8 Overhead crane

Prior to deactivation, an overhead crane was used in Bldg. 3030 to provide a means of moving heavy equipment in and around the hot cell. The overhead crane was determined to be contaminated from the process activities performed prior to deactivation.

3.1.4.9 Plant air system

Prior to deactivation, the plant air system provided 110 psig air to Bldg. 3030. The plant air system was regulated and used for process activities and instrumentation throughout the facility. The plant air system is not believed to be contaminated.

3.1.4.10 Hot cell manipulators

Prior to deactivation, the hot cell manipulators provided a means of remote process operation within the hot cell. The hot cell is equipped with Model 8 manipulators.

Prior to deactivation, the hot cell manipulator boots and seals were determined to be in poor condition and a potential for the spread of contamination from the hot cells.

3.1.4.11 Central ventilation system

Prior to deactivation, the central ventilation system provided exhaust ventilation services to the hot cell in Bldg. 3030. The central ventilation system for Bldg. 3030 was filtered through HEPA filters prior to discharge to the 3039 stack.

The central ventilation system was determined to be contaminated from the process activities performed prior to deactivation.

3.1.4.12 Local ventilation system

Prior to deactivation, the local ventilation system provided exhaust ventilation services to the hoods in Bldg. 3030. The local ventilation system for Bldg. 3030 was filtered through HEPA filters prior to discharging to the atmosphere.

The local ventilation system was determined to be very slightly contaminated from the process activities performed prior to deactivation.

3.1.5 Radioactive Material, Contamination, and Waste

Table 1 lists the radioactive contamination levels identified on radiation surveys conducted prior to deactivation.

Table 1. Predeactivation Radioactive Contamination Levels

Identification	Description	Quantity
Hot cell	alpha smear - transferable contamination	less than 500 dpm/100cm ²
Hot cell	beta/gamma smear - transferable contamination	up to 21 mRad/h/100cm ²
Hood #1,#2,#3	alpha smear - transferable contamination	less than 500 dpm/100cm ²
Hood #1	beta/gamma smear - transferable contamination	1799 dpm/100cm ²
Hood #2	beta/gamma smear - transferable contamination	5943 dpm/100cm ²
Hood #3	beta/gamma smear - transferable contamination	1134 dpm/100cm ²
General area	alpha smear - transferable contamination	less than 500 dpm/100cm ²
General area	beta/gamma smear - transferable contamination	up to 350,000P dpm/100cm ²

Table 2 lists radiation levels identified on radiation surveys conducted prior to deactivation:

Table 2. Predeactivation Radiation Levels

Identification	Description	Quantity
Hot cell	fixed and transferable radiation levels	1 Rem/hr
Hood #1	fixed and transferable radiation levels	1.5 mRem/hr
Hood #2	fixed and transferable radiation levels	6 mRem/hr
Hood #3	fixed and transferable radiation levels	20 mRem/hr
General area	fixed and transferable radiation levels	up to 1.2 mRem/hr

3.1.6 Hazardous Materials and Waste

Table 3 lists the hazardous materials and waste identified during facility walkdowns prior to deactivation.

Table 3. Bldg. 3030 Predeactivation Hazardous Materials and Waste

Identification	Description	Quantity
Lead-based paint	Used as wall covering throughout building.	indeterminate
Asbestos floor tiles	Used as floor covering throughout the building.	approx. 825 ft ²
Asbestos lagging	Used as pipe lagging throughout the building	indeterminate
PCBs	Electrical devices and transformers	indeterminate
Lead shielding	Used in hot cell walls and window	indeterminate
Mineral oil	Used in hot cell window	indeterminate

3.2 POST DEACTIVATION FACILITY STATUS

Attachment 3, "Postdeactivation Facility Photographs," contains photographs of the building conditions following deactivation activities.

3.2.1 Deactivation End Point Completion

End point criteria for deactivation activities and end point completion documentation are not applicable for Bldg. 3030. The requirement and guidance for these program elements were not developed prior to Bldg. 3030 deactivation.

3.2.2 Hazards Analysis

A postdeactivation hazards screening was performed. This hazards screening placed the facility in the "other industrial" category.

3.2.3 Internal Spaces

The miscellaneous items abandoned when the facility was no longer in use have been removed from the general area. No significant combustibles remain in the general area and the general area of Bldg. 3030 has been decontaminated to remove transferable contamination from access-required spaces. The lead-based paint is chipping and peeling, providing a means of transferring the lead and endangering personnel and the environment.

Postdeactivation radioactive contamination levels and radiation levels for this area are listed in Tables 4 and 5 respectively. Postdeactivation hazardous materials and waste located in this area are listed in Table 6.

3.2.4 Building Structure and External Spaces

The structure and roof of Bldg. 3030 were inspected and found to be in generally good condition, with the exception of some water leakage through various paths.

3.2.5 Process, Utility, and Support Systems

3.2.5.1 Electrical power system

All electrical services, with the exception of lighting, have been disconnected or de-energized at the main breaker box.

3.2.5.2 Fire protection system

The fire protection system is a dry system and remains available for use if there is a fire in the building.

3.2.5.3 Building steam system

The building steam system has been isolated, drained, and abandoned in place.

3.2.5.4 Potable water system

The potable water system has been isolated, drained, and abandoned in place.

3.2.5.5 Hot Drain System

The hot drain system has been abandoned in place. All hot cell drains have been plugged to isolate the hot cells and to prevent the potential spread of contamination.

The hot drain system remains highly contaminated from the process and cleaning activities performed prior to deactivation.

3.2.5.6 Process Drain System

The process drain system has been abandoned in place. However, the process drain system remains connected to the ORNL process waste system.

The process drain system remains contaminated from the process and cleaning activities performed prior to deactivation.

3.2.5.7 Natural Gas System

The natural gas system has been isolated, vented, and abandoned in place.

3.2.5.8 Overhead Crane

The overhead crane has been de-energized and abandoned in place. It remains contaminated from the process activities performed prior to deactivation.

3.2.5.9 Plant Air System

The plant air system has been isolated, vented, and abandoned in place.

3.2.5.10 Hot cell manipulators

The hot cell manipulator boots and isolation bags were removed and replaced. New boots were placed on the in-cell portion of the manipulators. The plastic boot and wiper seals around the manipulator were removed. The manipulator control arms are bagged as an added precaution.

3.2.5.11 Central ventilation system

The central ventilation system remains in operation to provide negative pressure for contamination control for the hot cell. All controls associated with the central ventilation system remain in operation as well.

The central ventilation system remains highly contaminated from the process activities performed prior to deactivation.

3.2.5.12 Local ventilation system

The local ventilation system has been removed from service and shutdown. It is slightly contaminated from the process activities performed prior to deactivation.

3.2.6 Radioactive Material, Contamination, and Waste

Table 4 lists the radioactive contamination levels identified on radiation surveys conducted following deactivation.

Table 4. Postdeactivation Radioactive Contamination Levels

Identification	Description	Quantity
Hot cell	alpha smear - transferable contamination	less than 500 dpm/100cm ²
Hot cell	beta/gamma smear - transferable contamination	1.0 to 100000 dpm/100cm ²
Hood #1	alpha smear - transferable contamination	less than 500 dpm/100cm ²
Hood #1	beta/gamma smear - transferable contamination	No detectable contamination
Hood #2	alpha smear - transferable contamination	less than 500 dpm/100cm ²
Hood #2	beta/gamma smear - transferable contamination	No detectable contamination
Hood #3	alpha smear - transferable contamination	less than 500 dpm/100cm ²
Hood #3	beta/gamma smear - transferable contamination	No detectable contamination
General area	alpha smear - transferable contamination	less than 500 dpm/100cm ²
General area	beta/gamma smear - transferable contamination	No detectable contamination

Table 5 lists radiation levels identified on radiation surveys conducted prior to deactivation.

Table 5. Postdeactivation Radiation Levels

Identification	Description	Quantity
Hot cell	fixed and transferable radiation levels	22 mRem/hr
Hood #1	fixed and transferable radiation levels	0.2 mRem/hr
Hood #2	fixed and transferable radiation levels	0.3 mRem/hr
Hood #3	fixed and transferable radiation levels	5.0 mRem/hr
General area	fixed and transferable radiation levels	0.1 mRem/hr

3.2.7 Hazardous Materials and Waste

Table 6 lists the hazardous materials and waste identified during facility walkdowns following deactivation

Table 6. Bldg. 3030 Postdeactivation Hazardous Materials and Waste

Identification	Description	Quantity
Lead-based paint	Used as wall covering throughout building	indeterminate
Asbestos floor tiles	Used as floor covering throughout the building	approx. 825 ft ²

Table 6. (continued)

Identification	Description	Quantity
Asbestos Lagging	Used as pipe lagging throughout the building	indeterminate
PCBs	Electrical devices and transformers	indeterminate
Lead shielding	Used in hot cell walls and window	indeterminate
Mineral oil	Used in hot cell window	indeterminate

4. BLDG. 3030 DEACTIVATION ACTIVITIES

The following section addresses the major activities performed during the deactivation of Bldg. 3030. The objectives of the deactivation process were to place the facility in a passively safe and environmentally stable configuration that can be efficiently and cost-effectively maintained indefinitely. The major deactivation issues, with regard to Bldg. 3030, are listed below:

4.1 INTERNAL SPACES; ACCESS REQUIRED

4.1.1 General Areas

All storage cabinets, desks, file cabinets, and miscellaneous office materials were removed from the building. Some were green-tagged for reuse. The remaining items were disposed of.

The asbestos floor tiles were not removed and are not intended to be removed until facility decontamination and decommissioning.

The walls in the building are covered with lead-based paint. Peeling and flaking areas have been repaired, but the remainder of the paint will remain as is. Paint condition is an inspection item in the S&M plan for Bldg. 3030.

4.2 INTERNAL SPACES; NO ACCESS REQUIRED

4.2.1 3030 Hot Cell

The following deactivation activities were performed in the hot cell:

- The hot cell manipulator boots and isolation bags were removed and replaced. New boots were placed on the in-cell portion of the manipulators. The plastic boot and wiper seals around the manipulator were removed.
- The hot cell was wiped down to reduce airborne contamination.
- All hot cell service lines were identified, labeled, and plugged.
- All in-cell filters were removed.
- All hot cell drains were plugged.
- Access to the hot cell was secured.

4.3 EXTERNAL SPACES

4.3.1 Bldg. 3030 Structure

The exterior of Bldg. 3030 was inspected and found to be in generally good structural condition. The building exterior has been cocooned to eliminate air and water inleakage and to provide effective containment for the building.

4.3.2 Bldg. 3030 Roof

The roof of Bldg. 3030 was repaired/inspected and found to be in generally good structural condition.

4.4 OPERATIONAL SYSTEMS

4.4.1 Electrical Power System

All electrical services that were not essential to the basic surveillance and maintenance operations were disconnected at the main breaker box.

4.4.2 Fire Protection System

The fire protection system is a dry pipe delivery system available in case of a building fire.

4.4.3 Hot Drain System

The hot cell drains were plugged with Plexiglas plugs to isolate the hot cells and prevent the spread of contamination. No decontamination of the hot drain system has been performed.

4.4.4 Process Drain System

The process floor drains remain in operation to direct any roof inleakage to the ORNL process waste system and prevent any uncontrolled contamination from leaving the building. No decontamination of the process drain system has been performed.

4.4.5 Central Ventilation System

The central ventilation system remains in operation to provide negative pressure for contamination control for the hot cell. All controls associated with this system remain in operation as well. No decontamination of the central ventilation system has been performed.

4.4.6 Local Ventilation System

The local ventilation system has been removed from service and shut down in place. No decontamination of the local ventilation system has been performed.

4.5 "MOTHBALLED" SYSTEMS

There are no "mothballed" systems associated with Bldg. 3030.

4.6 ABANDONED SYSTEMS

4.6.1 Building Steam System

The building steam system supply was drained and valved off.

4.6.2 Potable Water System

The incoming line of the potable water system has been capped, isolating the system from Bldg. 3030.

4.6.3 Hot Cell Manipulators

The hot cell manipulator boots and isolation bags were removed and replaced. New boots were placed on the in-cell portion of the manipulators. The plastic boot and wiper seals around the manipulator were removed. Decontamination was performed, as required, during manipulator boot replacement.

4.6.4 Natural Gas System

The natural gas system was vented and valved off.

4.6.5 Overhead Crane

The overhead crane was de-energized and abandoned in place. Minor decontamination was performed on the overhead crane to minimize the potential spread of contamination.

4.6.6 Plant Air System

The plant air system has been depressurized and valved off.

5. TRANSITION ACTIVITIES

Building 3030 will be officially transferred from DOE's EM-60 program to the EM-40 program by a Memorandum of Agreement (MOA). The building will be accepted "as is" by EM-40 at the time of transfer.

5.1 MEMORANDUM OF AGREEMENT

The MOA documents the requirements agreed upon between EM-40 and EM-60. The signed MOA indicates acceptance by EM-40 that the criteria outlined in the MOA have been completed

satisfactorily, with the exception of post-transition punchlist items, and that the level of deactivation of the facility is acceptable for transition to the EM-40 program.

Post-transition punchlist items will be finished after deactivation is complete. The details of how the punchlist items will be completed and documented will be addressed in the MOA.

5.2 POST-TRANSITION ACTIVITIES

No Post-Transition punchlist items have been identified for Bldg. 3030. All deactivation activities have been completed prior to transfer to EM-40.

6. POSTDEACTIVATION S&M

The "Postdeactivation S&M Plan for Building 3030" covers S&M activities associated with the interior spaces, operational and mothballed systems, and external areas related to Bldg. 3030.

The specific objectives of the S&M program for Bldg. 3030 are as follows:

1. Ensure adequate containment of contamination,
2. Provide physical safety and security control,
3. Maintain the facility in a manner that will minimize potential hazards to the public, and
4. Provide a mechanism for the identification and compliance with applicable environmental, safety, and health requirements.

The "Postdeactivation S&M Plan for Building 3030" details the specific S&M items to be performed and estimates the annual cost of performance. The S&M cost estimates are based on previous operational costs associated with similar S&M activities at ORNL.

The S&M activities associated with Bldg. 3030 include the following types of activities:

- Walkdowns and inspections for structural integrity, safety, radioactive contamination, and hazardous material conditions;
- General housekeeping of the interior and exterior of the building as needed; and
- Maintenance activities required to maintain the security and safety envelope of the facility.

7. ABNORMAL ACTIVITIES/CONDITIONS

No Abnormal Activities/Conditions have been identified for Bldg. 3030.

8. TURNOVER PACKAGE DOCUMENTATION

8.1 ADMINISTRATIVE TURNOVER PACKAGE

Administrative turnover consists of a collection of administrative documents. This includes procedures, agreements, and other documents not directly related to the physical facility. The level of detail depends on the conditions, requirements, and agreements specific to the facility.

Attachment 4, "Administrative Turnover Package Checklist," reflects the documents required for this facility with respect to administrative turnover. The following sections detail the contents of the applicable sections required for Bldg. 3030.

8.1.1 Final Deactivation Project Report

The FDPR is a management summary of the facility deactivation completion and its general status and conditions that demonstrates conformance with DOE's specification of the overall end point. It identifies management actions needed that are not routine. Unresolved issues are also described.

8.1.2 Regulatory Compliance Documentation

Regulatory compliance documentation includes the status/compliance of all regulatory commitments; for example, status of compliance with applicable regulations promulgated pursuant to statutes, such as Occupational Safety and Health Administration, RCRA, CERCLA, the National Environmental Policy Act, and the remediation process in the National Contingency Plan.

8.1.3 Interagency Agreements Documentation

Interagency agreements documentation includes Interagency Agreements that identify the terms and milestones of agreements pending and entered into by DOE with federal, state, and local agencies and the status of compliance. This includes settlement agreements, administrative or consent orders, and compliance plans to settle outstanding notices of violation.

8.1.4 Existing Permit Documentation

Existing permit documentation includes the status of existing permits, including National Pollutant Discharge Elimination System (NPDES), air permits, RCRA, and others associated with the facility.

8.1.5 Corrective Action Documentation

Corrective action documentation addresses the status of corrective actions completed and outstanding, from previous audits, inspections, and other similar activities (e.g., Tiger Team, Technical Safety Appraisal, Defense Nuclear Facility Safety Board, regulatory agencies, self assessments, business systems review), including identification of those items that need to be reevaluated and reviewed with respect to the facility's surplus condition.

8.1.6 Deactivation Locks and Keys

All deactivation locks and keys for facility access, isolation of electrical components, chaining of valves, and other situations where physical access is to be controlled will be turned over to EM-40 at the time of transfer.

8.2 TECHNICAL TURNOVER PACKAGE

Technical turnover consists of a collection of technical documents that describe the facility, its equipment, and the conditions at the completion of all deactivation activities. The level of detail depends on the conditions, requirements, and agreements specific to the facility. Attachment 5, "Technical Turnover Package Checklist," reflects the documents required for this facility with respect to technical turnover. The following sections detail the contents of the applicable sections required for Bldg. 3030.

8.2.1 Updated Facility Drawings (Arrangement, PID, Loop, Etc.)

Updated facility drawings include facility, room, and cell arrangement drawings—to the extent they exist. However, except in unique circumstances, as-builts of the deactivated conditions within the facility are not provided. Attachment 6 contains the drawing list for Bldg. 3030. This documentation provides status (including drawings) of the deactivation/safe shutdown (if applicable), and addresses systems, such as the water, sewer, air, electric, gas, process (mechanical and chemical) and fire protection systems.

Table 7. Bldg. 3030 Updated Drawings

Number	Rev.	Title
D-37907	A	Manipulator Cell - Service Piping & Ventilation - Sections & Details
D-6615	A	Isotope Process Area - Process Bldg. "C" - Heating & Exhaust System
E-30097		Storage Vault - Mechanical & Electrical - Plans & Details - Sheet 3
H203369EG-002-D	001	A/C Elec. Roof Plan A/C Units Isotope Area
D-51926	A	Enclosure Bldgs. 3030 and 3031 - Ventilation
D-51926		Piping, Htg. & Vent.

8.2.2 "As Left" Photos of Spaces and Major Equipment

"As left" photos include descriptions/photos of spaces for which no access is anticipated during S&M.

8.2.3 Hazardous Materials Inventory and Survey

Location of fixed hazardous materials, wastes, and contamination with characterization information.

8.2.4 Safeguards and Security Documentation

Inventory and Safeguards and Security documentation provides for nuclear or other material remaining in the facility for which there is a requirement for accountability or protection from diversion.

8.2.5 Chemical Substance Inventory and Survey

The chemical substance inventory and survey inventories chemical and hazardous substances remaining, if any, and contains characterization information.

8.2.6 Radioactive Materials Inventory and Survey

The radioactive materials inventory and survey inventories radioactive and fissile material remaining as contamination and includes characterization information.

The final radiological/hazardous materials survey records, final configuration and surveillance and maintenance requirements, available drawings, specifications, procedures, manuals, and unplanned occurrences records applicable to the facility. Attachment 8 contains the radiological survey data.

8.2.7 Facility Soil, Surface Water, and Groundwater Condition Report

The Facility Soil, Surface Water, and Groundwater Condition Report describes soil, surface water, and groundwater conditions at the facility, provides all available data, and lists reports that describe those conditions and the nature and extent of contamination therein. This report Also identifies any known assessment requirements.

8.3 S&M TURNOVER PACKAGE

S&M turnover consists of a collection of documents required to support postdeactivation S&M activities. The level of detail depends on the S&M specific to the facility. Attachment 8, "S&M Turnover Package Checklist," reflects the documents required for this facility with respect to S&M turnover. The following sections detail the contents of the applicable sections required for Bldg. 3030.

8.3.1 Postdeactivation S&M Plan

This document describes the S&M plan for the facility after deactivation is complete, up to the initiation of decommissioning. The S&M activities will be integrated into the decommissioning work and phased out as decommissioning is completed.

8.3.2 Postdeactivation S&M Updated Safety Equipment List

This document describes the safety equipment that will remain in the facility during the postdeactivation S&M period.

8.3.3 Postdeactivation S&M Procedures

Table 8 contains a list of procedures required during the postdeactivation S&M period. These procedures outline the maintenance activities and special surveillances required to ensure that the facility conditions and safety envelope remain consistent until decommissioning can take place.

Table 8. Bldg. 3030 S&M Procedures

Number	Procedure Title
IP-1418	Manipulator Removal, Repair, and Replacement
IP-1313, Rev. 2	Local and Central Ventilation System HEPA Filter Replacement

9. ASSOCIATED LITERATURE


Document Number	Document Title
Draft	Facility Deactivation End Points Handbook; Volume 1: Method and Examples
Draft	Facility Deactivation End Points Handbook; Volume 2: Deactivation Practices
DOE/EM-0246	Decommissioning Resource Manual. August 1995
ORNL/ER-249/R2	Martin Marietta Environmental Restoration Program; Work Plan for the Isotopes Facilities Deactivation Project at Oak Ridge National Laboratory, August 1995
	Oak Ridge National Laboratory; Local Emergency Manual, Isotope Area, Revision 94-1, January 1994

10. ATTACHMENTS

1. Bldg. 3030 Floor Plan
8. Bldg. 3030 Predeactivation Facility Photographs
9. Bldg. 3030 Postdeactivation Facility Photographs
10. Administrative Turnover Package Checklist
11. Technical Turnover Package Checklist
12. Bldg. 3030 Drawing List
13. Bldg. 3030 Radiological Survey Data
14. S&M Turnover Package Checklist

ATTACHMENT 1
BLDG. 3030
FLOOR PLAN

Building 3030

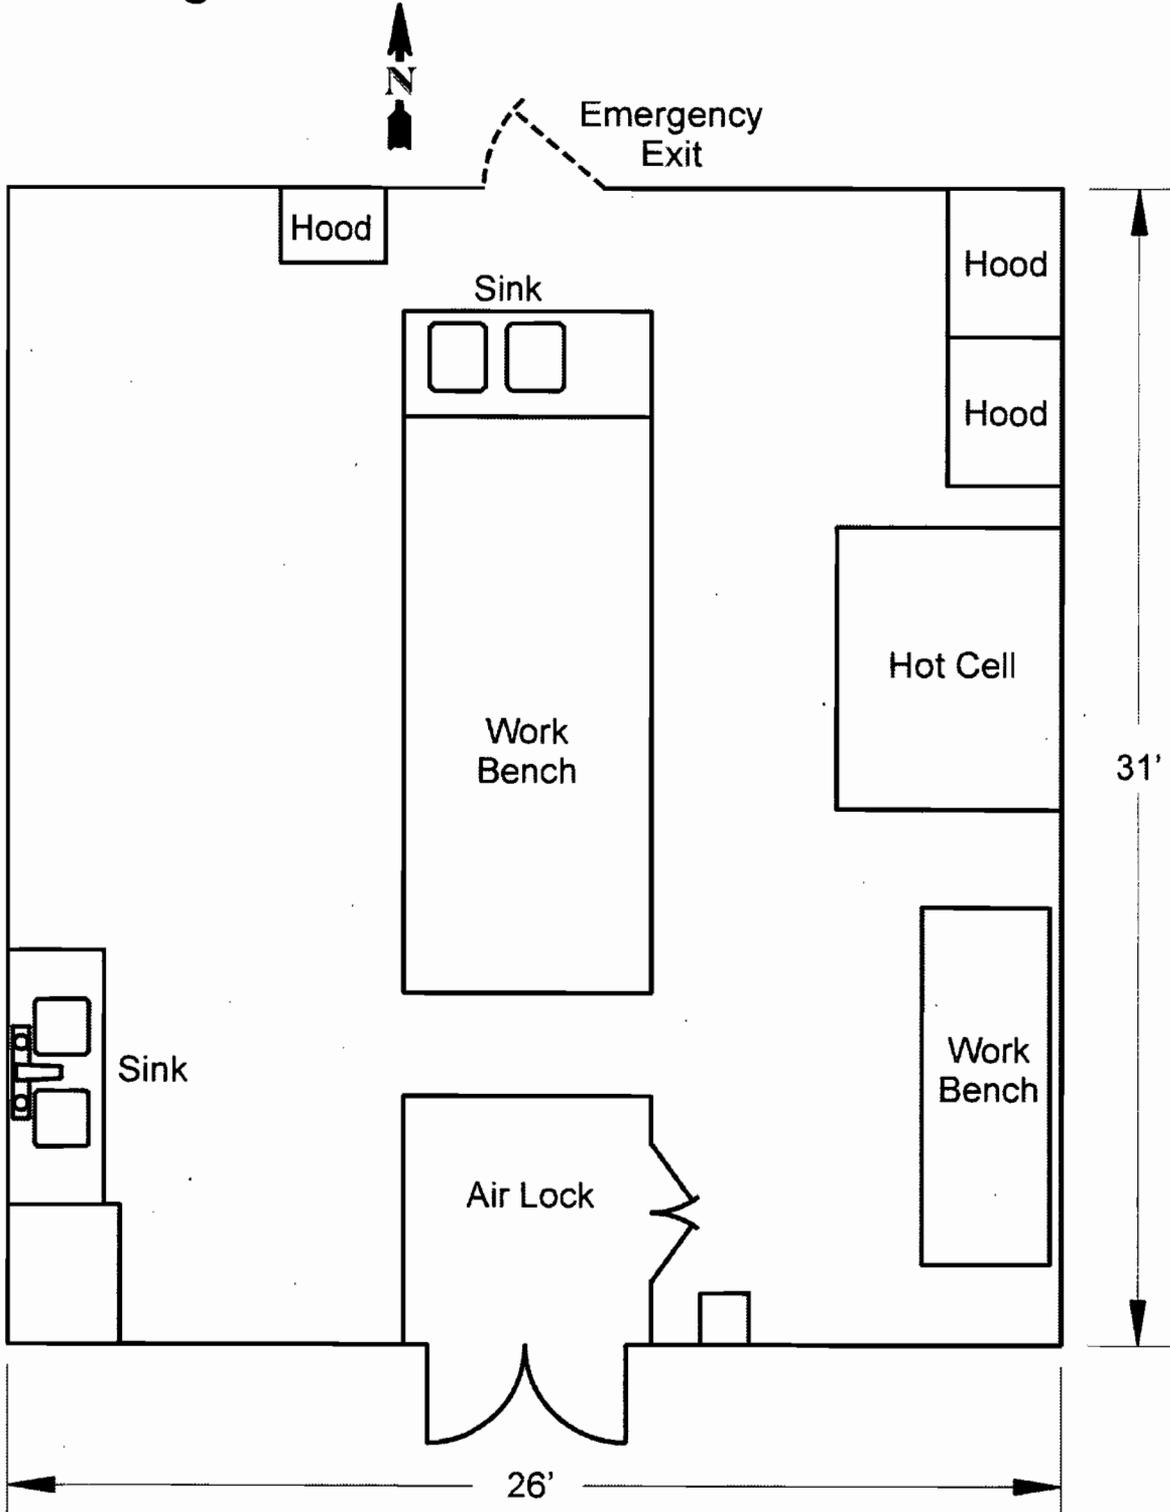

ATTACHMENT 2
BLDG. 3030
PREDEACTIVATION FACILITY PHOTOGRAPHS






Fig. 2-1. Bldg. 3030: predeactivation.

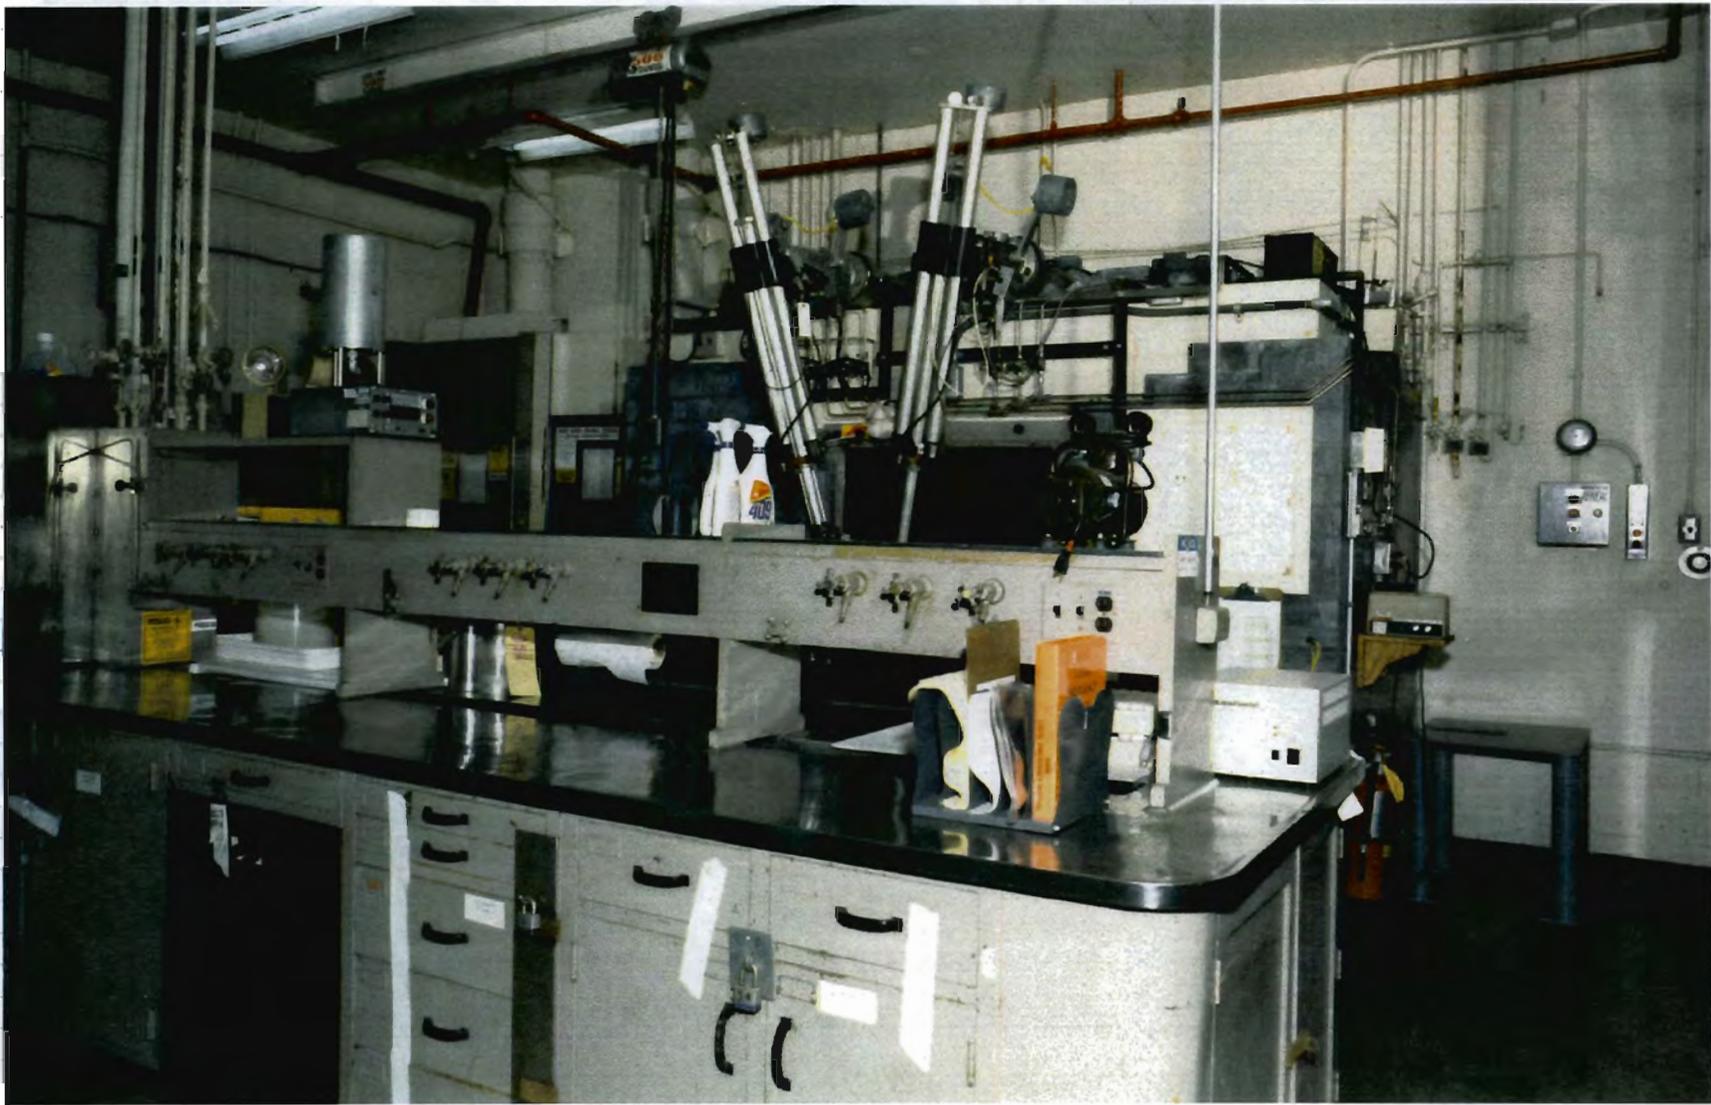


Fig. 2-2. Bldg. 3030: predeactivation.

ATTACHMENT 3
BLDG. 3030
POSTDEACTIVATION FACILITY PHOTOGRAPHS

THE UNIVERSITY OF CHICAGO
LIBRARY


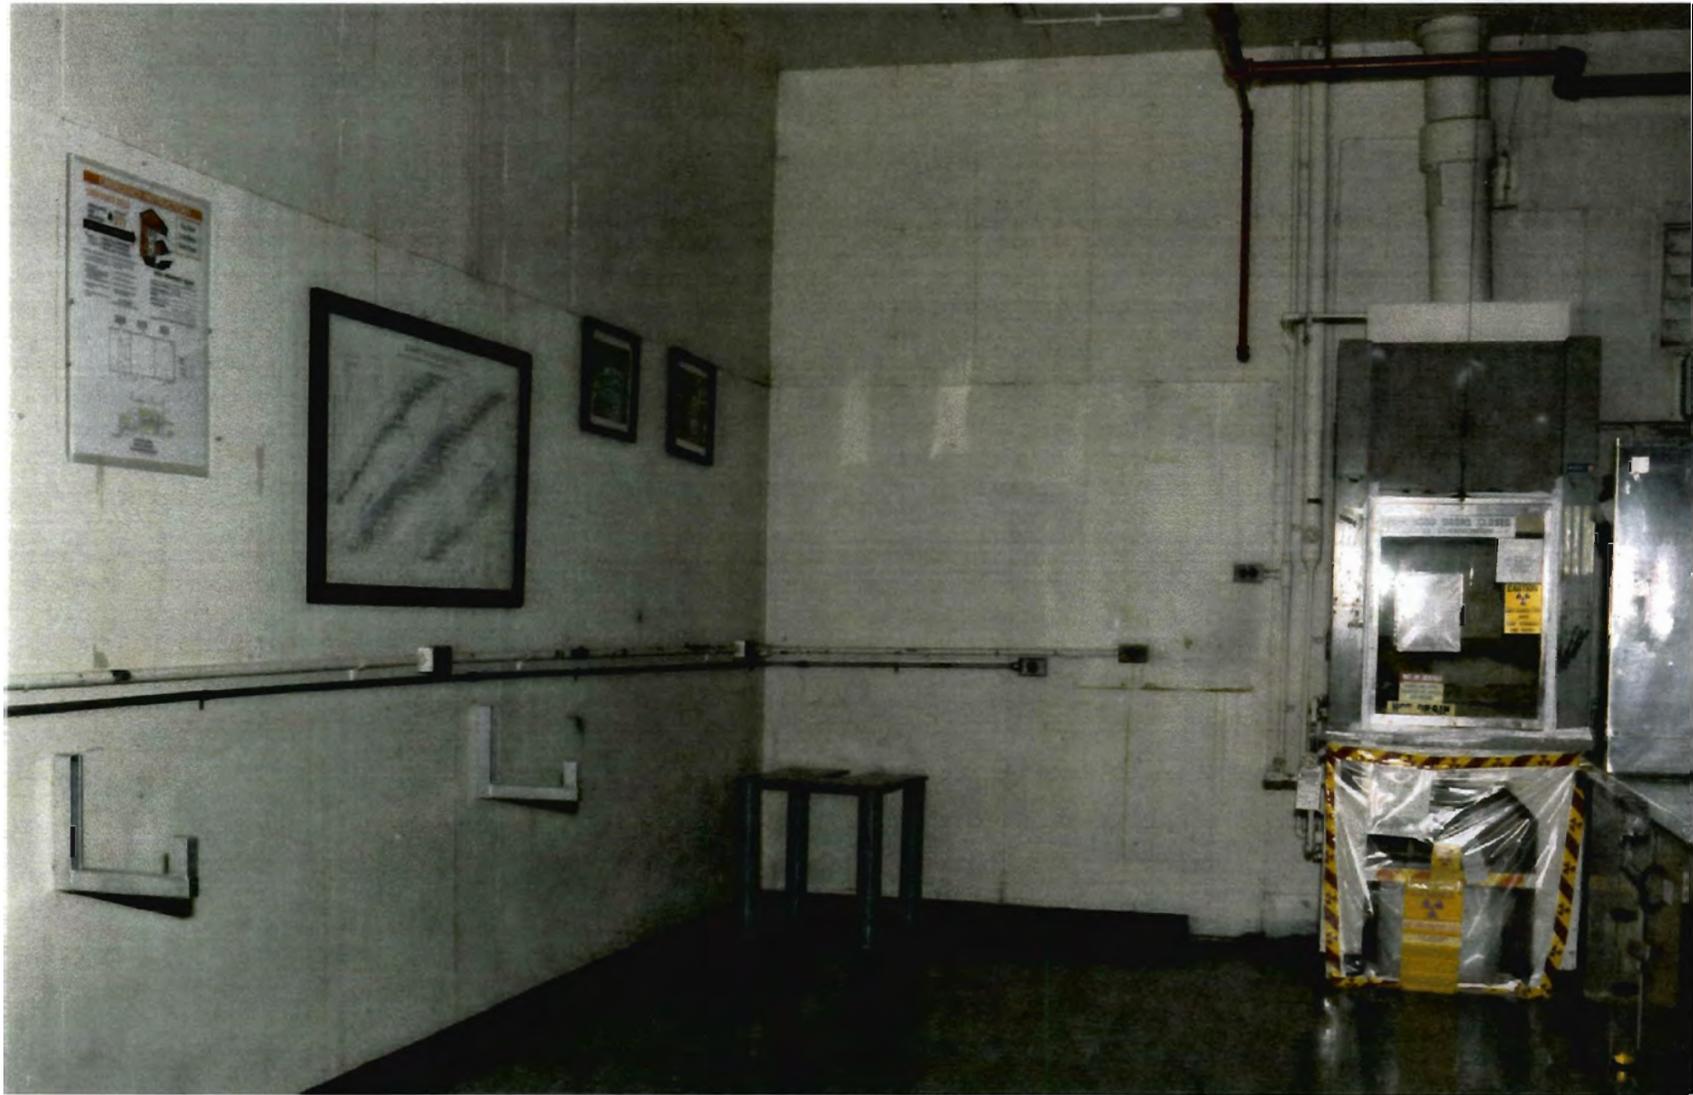


Fig. 3-1. Bldg. 3030: postdeactivation.



Fig. 3-2. Bldg. 3030: postdeactivation.


**ATTACHMENT 4
ADMINISTRATIVE TURNOVER
PACKAGE CHECKLIST**



Administrative Turnover Package Checklist

Item Number	Document	Applicable ?
1	Final Deactivation Project Report	Yes
2	Emergency Response Plan	No
3	Safety Documentation (Category III or greater)	No
4	Regulatory Compliance Documentation	No
5	Interagency Agreements Documentation	No
6	Existing Permit Documentation	No
7	Corrective Action Documentation	No
8	Postdeactivation Punchlist	No
9	Deactivation Locks and Keys	Yes

**ATTACHMENT 5
TECHNICAL TURNOVER
PACKAGE CHECKLIST**

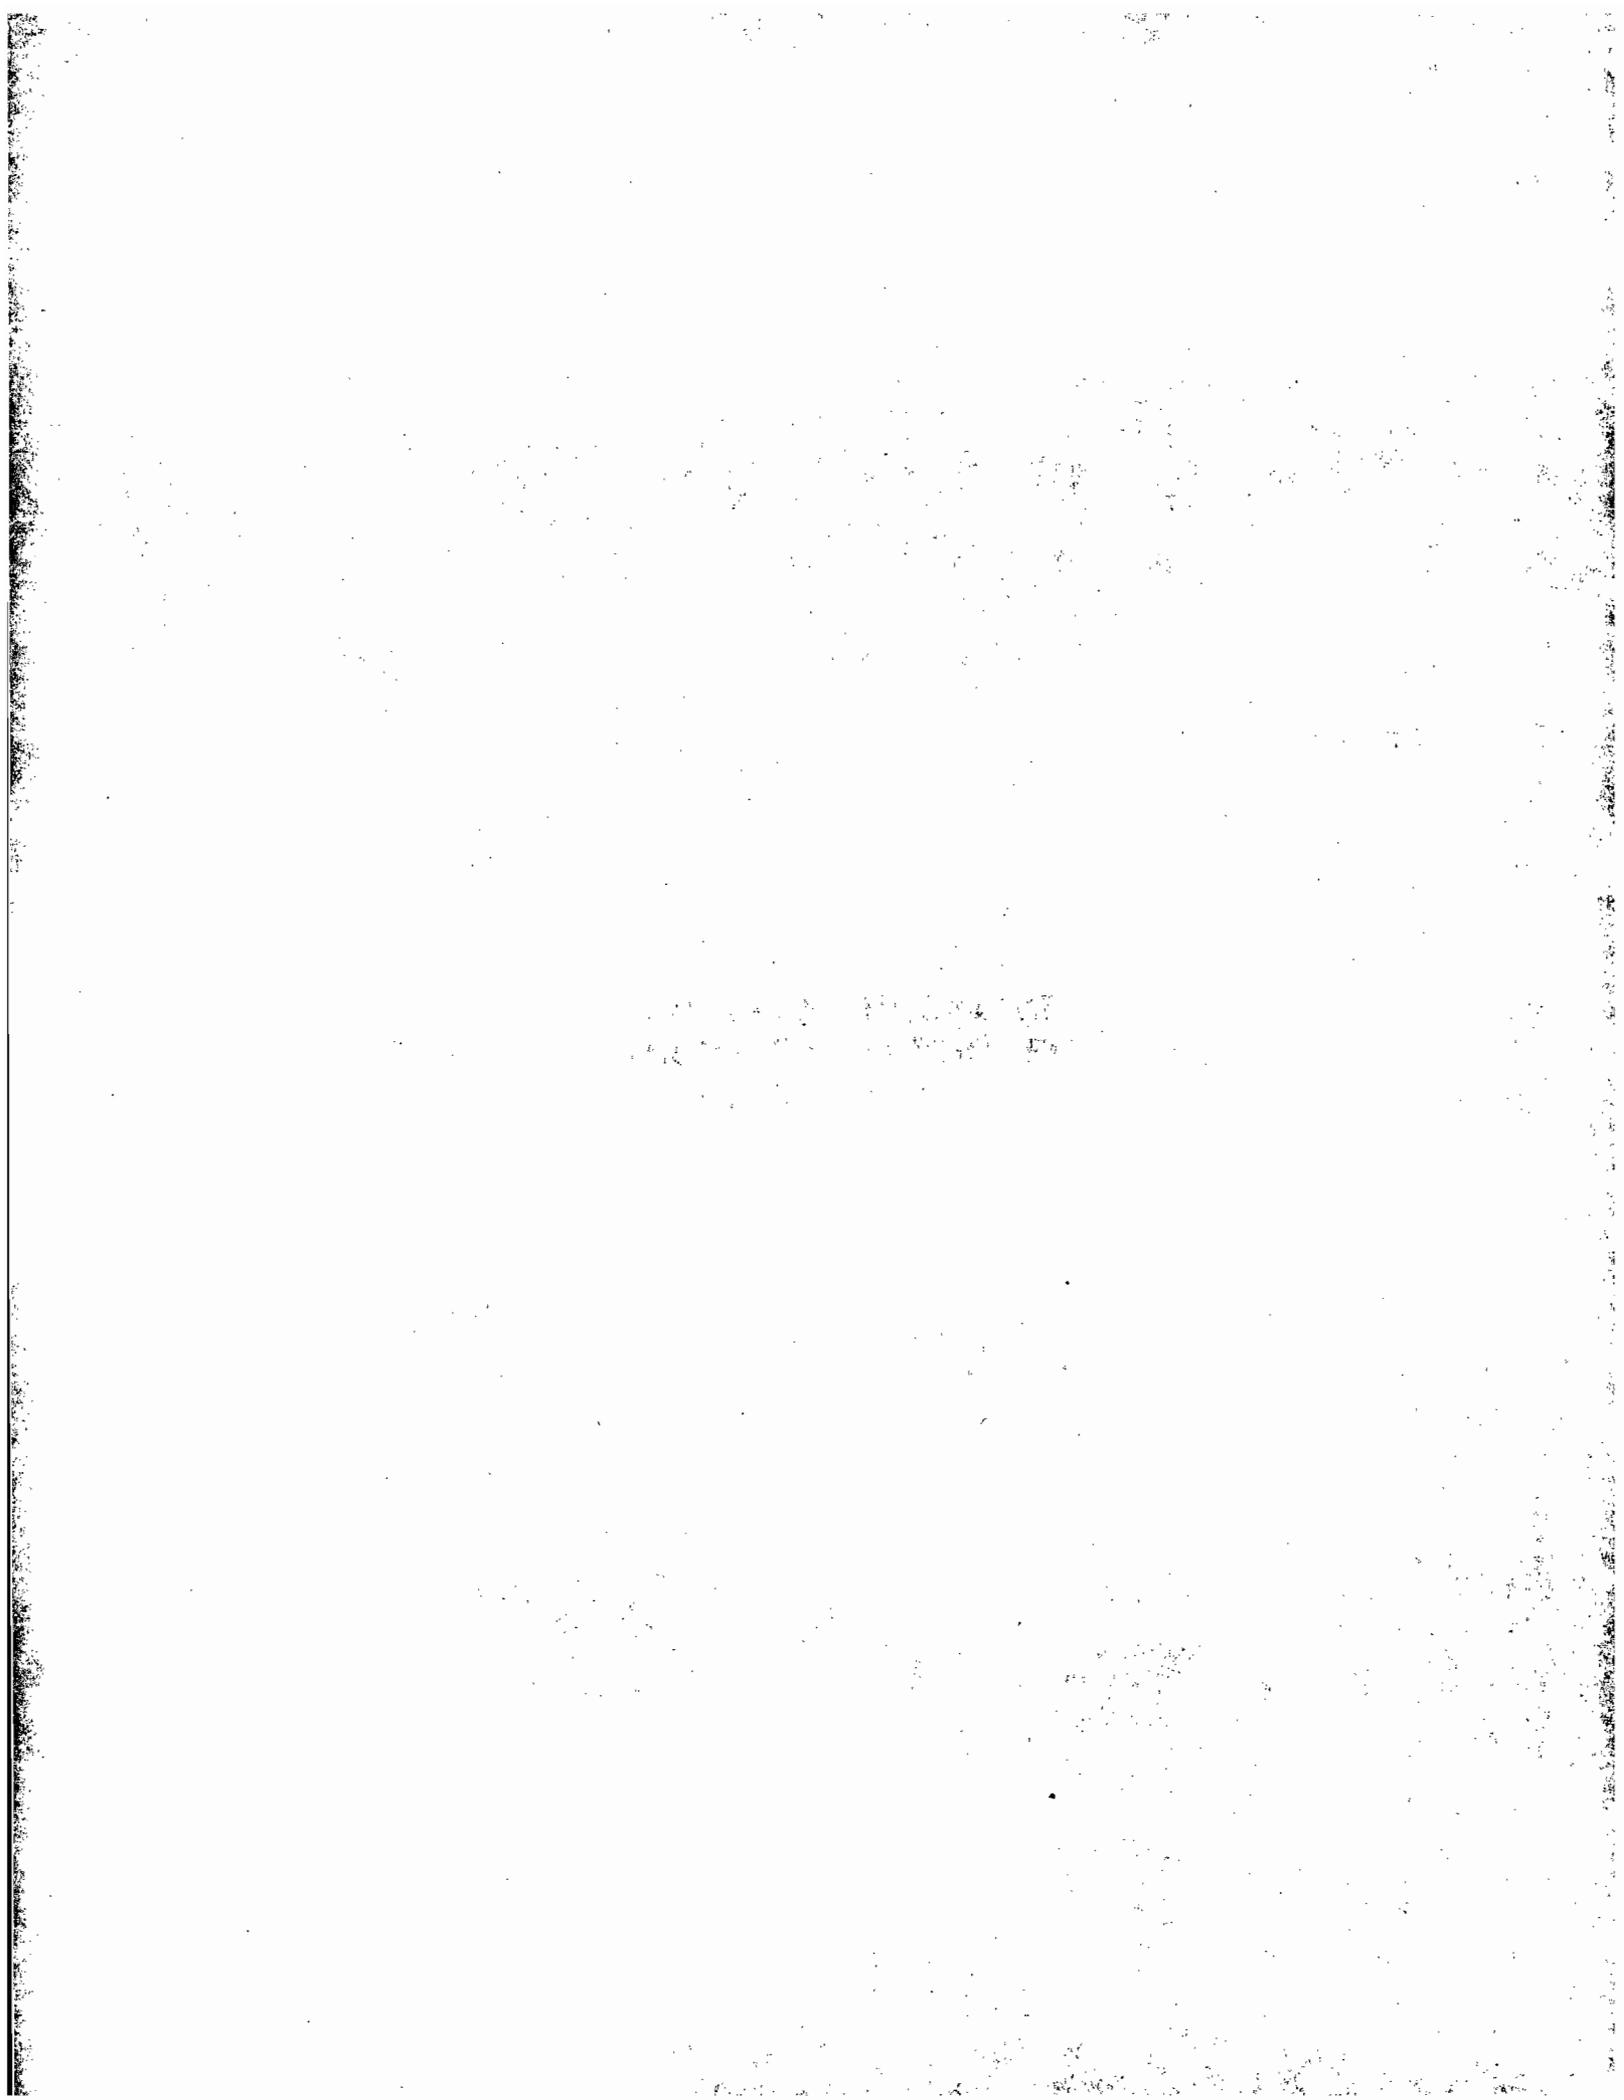

Technical Turnover Package Checklist

Item Number	Document	Applicable ?
1	End Point Determination Report	No
2	End Points Completion Report	No
3	End Point Technical Information	No
4	Deactivation Work Plans	No
5	Updated Facility Drawings (arrangement, PID, Loop, etc.)	Yes
6	“As Left” Photos of Spaces and Major Equipment	Yes
7	Hazardous Material Inventory and Survey	No
8	Safeguards and Security Documentation	No
9	Chemical Substance Inventory and Survey	No
10	Radioactive Materials Inventory and Survey	No
11	Facility Soil, Surface Water, and Groundwater Condition Report	Yes

ATTACHMENT 6
BLDG. 3030
DRAWING LIST

Bldg. 3030 Drawing List

Document Number	Revision	Title
C3E-020366-A001		Reroof Bldgs. 303, 3031, 3118 - site access plan and drawing index
D-18749		Manip cell elec plan & sects
D-19819		Manipulator cell - service piping, drains & exhaust
D-19820		Manipulator Cell - service piping & exhaust detail
D-20525		Alterations existing cell top view front elec sect
D-20526		Alterations existing cell plot plan sect elev det
D-20527		Roof plan, sects & front elev.
D-20567		Roof plan, sects & front elev.
D-20568		Plot plan, sect. elev. & dets
D-20569		67 lead door dets
D-20570		Misc dets sht 1
D-20571		Misc dets sht 2
D-43620		Driveway & curb alteration & new man hole cover
D-51920		Elec & fire det plans
D-51926		Enclosure Bldgs. 3030 and 3031 - ventilation
D-52252		Foundation plan, sect & dets
D-52253		Floor plan & steel framing dets
D-52254		wall sects & door sched
D-5545		20 ft hot barricades foundation plant & det
D-5546		20 ft hot barricades structural plan & elev
D-5547		20 ft hot barricades lead wall framing dets
D-5556		Machine barricade plan & elev.
D-5557		Machine barricade sects & dets
D-5709		Mach barricade hoods sect & dets
D-5744		20 ft hot barricades exh hood
D-6640		D building serv piping plan, sect & dets
E20366EF-003-D		South wall encl elec fire det plans
E20378D-001-D		440v elec feeder new 440v isotope area distr plot pl
E3E-20375-D003		Fire alarm plans
E-5622		Hot sink tables items 22-28 & 33-A
E-5730		Process bldg. exhaust hoods
H20366EG-001-D		A/C elec struc roof plan dets A/C units iso area
M20366EL-001-D		Cell window ext assy det

Bldg. 3030 Drawing List (continued)

Document Number	Revision	Title
ORNL/ENG/SR-221		Safety review reroof Bldgs. 3031, 3031, & 3118
ORNL/ENG/SR-221 R1		Safety review reroof Bldgs. 3031, 3031, & 3118
S20366EF-001-D		South wall encl steel framing plant dets
S20366EF-002-D		South wall encl steel framing exh dets
S3E-020366-B012		Reroof Bldgs. 3030, 3031, 3118 - roof plant, sections & details
S3E-020366-B013		Reroof Bldgs. 3030, 3031, 3118 - sections & details
X1989-0032-0003-008		Isotope processing facility functional criteria
X1991-0031-001		Memo: checking roofs for radiation contamination
X1991-0031-0003-006		Identification of bulk samples for asbestos content (asbestos survey)
X-RAP-0300-0		Risk assessment/plan for reroof Bldgs. 3030, 3031, & 3118

ATTACHMENT 7
BLDG. 3030
RADIOLOGICAL SURVEY DATA

ORNL Radiological Survey Data

Survey Number: 3038-96-1885 3038 Field Office Date: 8/29/96 Time: 10:15

Surveyor Badge Number: 626079 Routine Survey RWP Number: 3038-96-0040A

Building: 3030,3118 Specific Location: Bldg 3030 hot cell and 3118 @ rear cell door.

Description:

Enter 3030 hot cell via 3118 to remove waste, replace rings that hold bottom part of the manipulator boot on end do radiological survey.

Instruments Used and Calibration Due Date:

CTB-047	3/1/97	3038-11	2/11/97	3038-3P	3/26/97
---------	--------	---------	---------	---------	---------

General Description of Radiological Conditions: From previous survey

Maximum loose contamination: 350,000 dpm/100 cm sq beta-gamma. Maximum fixed contamination: 1 R/hr beta-gamma. The average whole body dose is 42.5 mR/hr beta-gamma. The smear results from the survey performed are listed below.

Division or Group Needing the Survey: CT Person-hours spent on the survey: 3.5

of Pages: 6 Completed By: D. Cross Reviewed by: J. Nantz Date: 1-29-97

Smear Results (dpm/100 cm² unless noted)

Smear Number	α	β	Location	Smear Number	α	β	Location	Smear Number	α	β	Location
1	NC	21.0 mR/hr	See map	2	NC	4.5 mR/hr	See map	3	NC	80,000	See map
4	NC	250,000	See map	5	NC	300,000	See map	6	NC	100,000	See map
7	NC	230,000	See map	8	NC	3.5 mR/hr	See map	9	NC	200,000	See map
10	NC	1,421	See map	11	NC	6,433	See map	12	NC	6,265	See map
13	NC	100,000	See map	14	NC	100,000	See map				

Description: Cell entry

Sampler Number	M133701	Flow Rate (cfm)	2.5	Date/Time Start	8/29/96	10:15
		Filter Efficiency	100.0%	Date/Time End	8/29/96	11:06
Date/Time Counted	9/5/96	8:59		Sample Time (min)	60.0	

	Alpha	Beta
Counter ID	CTA-041	CTB-047
Counter Efficiency	42.5%	14.4%
Background Counts	1	50
Bkgd Count Time (min)	5	5
Gross Sample Counts	4	24
Sample Count Time (min)	1	1
Sample DPM	8.9	97.2
Air Concentration (uCi/ml)	1.14E-12	1.24E-11
Min. Det. Conc. (uCi/ml)	1.29E-12	1.25E-11

AIR

SAMPLE

First Count Factor
79.87 N/A

ORNL Radiological Survey Data

L. Levonak / Lesano
626029

Survey Number: 3038-96-1835

3038 Field Office

Date: 8-29-96 Time: 1015

Hot Cell Bldg 3030

CTB-047


3038-3P

~~RSO-5~~ IR

3038-1I

Give only D/M on smear over
NC
2.00 dpa/100 cm² e
2.00 dpa/100 cm² i

B	B
* 121.0	34
* 4.5	35
80K	36
250K	37
300K	38
100K	39
230K	40
* 3.5	41
200K	42
101.421	43
* 16.433	44
* 6.265	45
100K	46
100K	47
	48
	49
	50
	51
	52
	53
	54
	55
	56
	57
	58
	59
	60
	61
	62
	63
	64
	65
	66

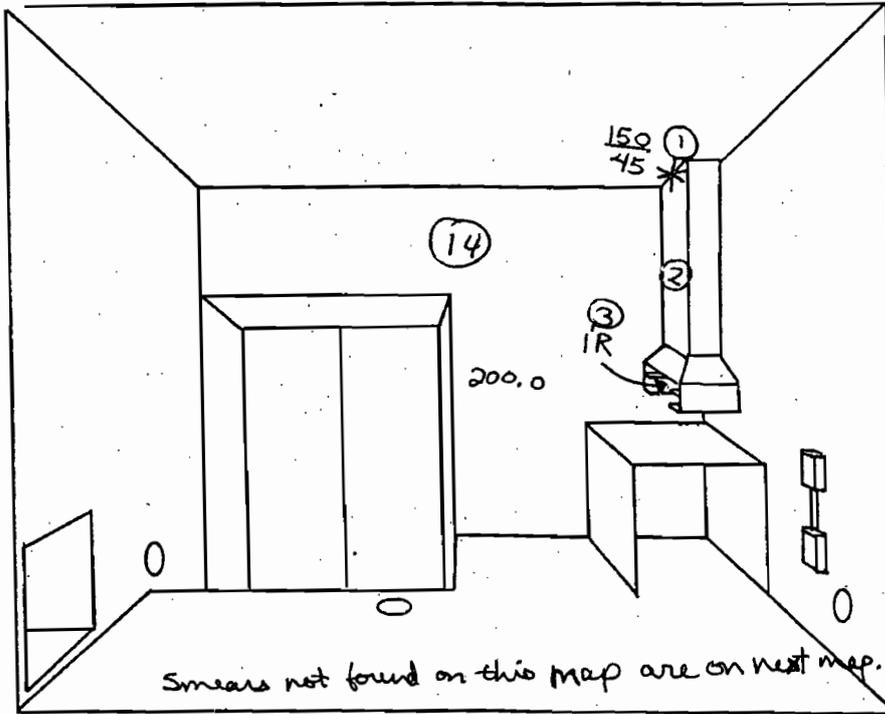

* Read with RSO-5 (mR/hr)
* Counted in CTB-047 (Beta counter)
The rest were read with a portable inst.

Symbol	Description	Boundary Designations	
⊙	- Smear Location	RA - Radiation Area	BA - Radiological Buffer Area
⊙	- Large Area Smear	HR - High Radiation Area	CA - Contamination Area
#	- Contact Dose Rate	VR - Very High Radiation Area	HC - High Contamination Area
#	- 30 cm Dose Rate	AR - Airborne Radioactivity Area	FC - Fixed Contamination Area
#	- General Area Dose Rate	RM - Radioactive Materials Area	SC - Soil Contamination Area
SOP	- Step-off Pad	UM - Underground Radioactive Materials Area	
AS	- Air Sample Location		


Default units are in mR/hr and are for open window beta/gamma readings. Letter suffixes with the number indicate specific radiations: B - Beta (mRad/hr), G - Gamma (mR/hr), N - Neutron (mRem/hr). Boundary designations are looking from the designations into the zoned area.

ORNL Radiological Survey Data

Survey Number: 3038-96-1885

3038 Field Office

Date: 8-29-96 Time: 1015

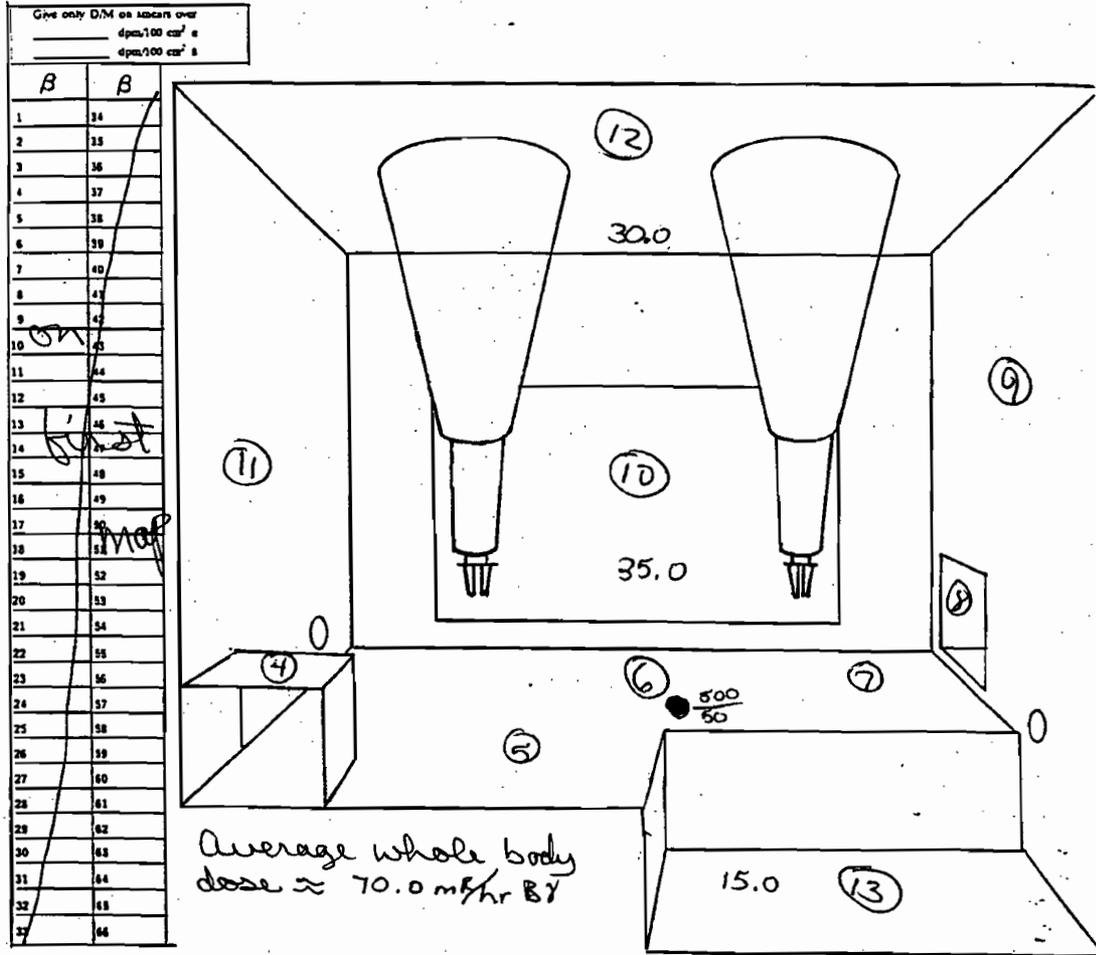

Boundary Designations	
① - Smear Location	RA - Radiation Area
② - Large Area Smear	HR - High Radiation Area
③ - Contact Dose Rate	VR - Very High Radiation Area
④ - 30 cm Dose Rate	AR - Airborne Radioactivity Area
⑤ - General Area Dose Rate	RM - Radioactive Materials Area
⑥ - Step-off Pad	UM - Underground Radioactive Materials Area
⑦ - Air Sample Location	BA - Radiological Buffer Area
	CA - Contamination Area
	HC - High Contamination Area
	FC - Fixed Contamination Area
	SC - Soil Contamination Area

Default units are in mR/hr and are for open window beta/gamma readings. Letter suffixes with the number indicate specific radiations: B - Beta (mRad/hr), G - Gamma (mR/hr), N - Neutron (mRem/hr). Boundary designations are looking from the designations into the zoned area.

ORNL Radiological Survey Data

Survey Number: 3038-95-1880

3038 Field Office

Date: 8/26/96

Time: 9:00

Surveyor Badge Number: 626079

 Routine Survey

RWP Number: 3038-95-0029

Building: 3030

Specific Location: On top of hot cell

Description:

Survey to determine contamination/radiation levels prior to upcoming work.

Instruments Used and Calibration Due Date:

CTB-047	3/1/97	3038-11	2/11/97
---------	--------	---------	---------

General Description of Radiological Conditions:

The highest smear was 9,975 dpm/100 cm sq beta-gamma. The highest dose rate was 300.0 mR/hr beta-gamma at contact with the back of the cell where it meets the wall and 20.0 mR/hr at 30 cm. After the manipulator work leftover lead was used to shield the 300 mR/hr spot down to < 5.0 mR/hr at 30 cm. The average whole body dose after this is ~ 1.1 mR/hr beta-gamma. Then the top of the cell was posted as a contamination area 8/29/96.

Division or Group Needing the Survey: CT

Person-hours spent on the survey: 2.5

of Pages: 2

Completed By: *Deborah Crossno*Reviewed by: *A. Alata*

Date: 12-3-96

Smear Results (dpm/100 cm² unless noted)

Smear Number	α	β	Location	Smear Number	α	β	Location	Smear Number	α	β	Location
1	NC	<200	See map	2	NC	<200	See map	3	NC	1,309	See map
4	NC	5,068	See map	5	NC	4,186	See map	6	NC	<200	See map
7	NC	273	See map	8	NC	9,975	See map	9	NC	553	See map
10	NC	329	See map	11	NC	847	See map				

ORNL Radiological Survey Data

626079

Survey Number: 3038-96-1880

3038 Field Office


Date: 8-26-96 Time: 0900

Bldg 3030

CTB-047, 3038-11

Give only D/M on scales over
 N/A dpm/100 cm² s
 200 dpm/100 cm² s

B	B
1	34
2	35
3	36
4	37
5	38
6	39
7	40
8	41
9	42
10	43
11	44
12	45
13	46
14	47
15	48
16	49
17	50
18	51
19	52
20	53
21	54
22	55
23	56
24	57
25	58
26	59
27	60
28	61
29	62
30	63
31	64
32	65
33	66

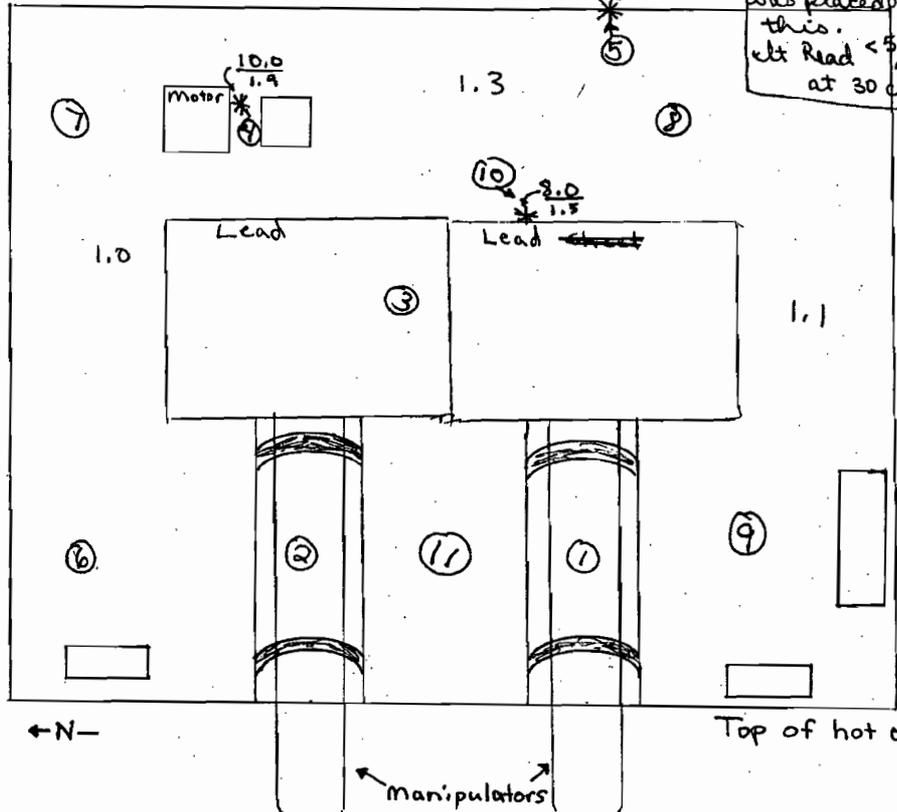

Average whole body dose = 1.1 mR/hr BY on 8-28-96.

Smear Location		Boundary Designations	
① - Smear Location	RA - Radiation Area	BA - Radiological Buffer Area	
② - Large Area Smear	HR - High Radiation Area	CA - Contamination Area	
# - Contact Dose Rate	VR - Very High Radiation Area	HC - High Contamination Area	
# - 30 cm Dose Rate	AR - Airborne Radioactivity Area	FC - Fixed Contamination Area	
# - General Area Dose Rate	RM - Radioactive Materials Area	SC - Soil Contamination Area	
[SOP] - Step-off Pad	UM - Underground Radioactive Materials Area		
AS - Air Sample Location			

Default units are in mR/hr and are for open window beta/gamma readings. Letter suffixes with the number indicate specific radiations: B - Beta (mRad/hr), G - Gamma (mR/hr), N - Neutron (mRem/hr). Boundary designations are looking from the designations into the zoned area.

The top of this cell was posted as a Contamination area after the manipulator pull.

ORNL Radiological Survey Data

Survey Number: 3038-95-1073	3038 Field Office	Date: 9/7/95	Time: 09:00
Surveyor Badge Number: 740988	<input type="checkbox"/> Routine Survey	RWP Number: 3038-95-0015	
Building: 3030	Specific Location: Roof and Attic		
Description: Personnel to enter roof and attic for inspections.			
Instruments Used and Calibration Due Date:			
3038-9B	2/13/96	3038-8P	10/16/95
3038-4I	1/29/95	CTB-047	2/20/96
		CTA-041	2/20/96
General Description of Radiological Conditions:			
Max. beta-gamma contamination levels were 7000 dpm/100cm ² . No alpha contamination was present. Max. Rad. field was 150 mr/hr at contact. The general working bkg was < 1mr/hr.			
Division or Group Needing the Survey: CT		Person-hours spent on the survey: 2	
# of Pages: 5	Completed By: <i>Carol B. Smith</i>	Reviewed by: <i>Slater</i>	Date: 9-13-95

ORNL Radiological Survey Data

Copy only OAM on station over
 760 contact ref :
 760 contact ref :


Survey Number: 3038-95-1073 3038 Field Office Date: 9-1-95 Time: 0700

3038 04I
 3038 08P
 3038 04B
 CTA-041
 CTB-047

Radiation/Contamination Survey.
 Dose rates due, mR/hr.
 in BLDG 3030 ATTIC

David B. Smith 740968
 Tony Paris 626444

A	B
1	220
2	220
3	220
4	3000
5	1000
6	220
7	220
8	220
9	220
10	220
11	220
12	220
13	220
14	5000
15	220
16	220
17	220
18	7000
19	220
20	220
21	220
22	220
23	350
24	220
25	220
26	220
27	220
28	220
29	220
30	220
31	220
32	220
33	220
34	220
35	220
36	220
37	220
38	220
39	220
40	220
41	220
42	220
43	220
44	220
45	220
46	220
47	220
48	220
49	220
50	220
51	220

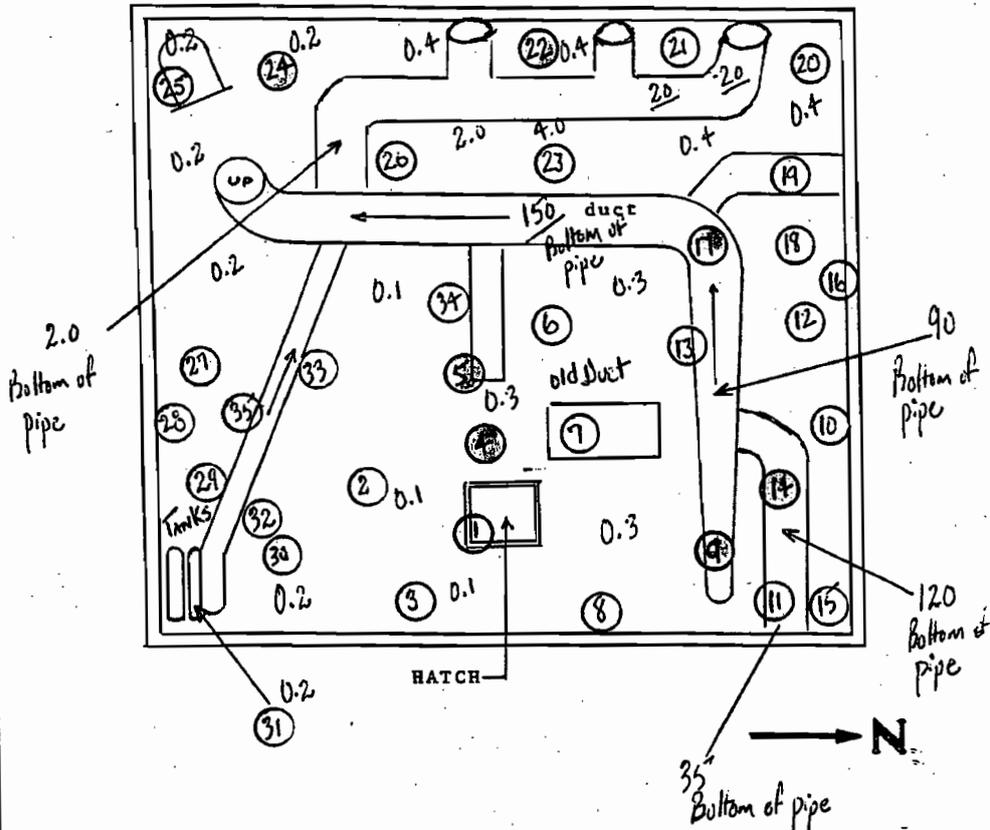

Legend		Boundary Designations	
⊙	- Smear Location	RA	- Radiation Area
⊖	- Large Area Smear	NR	- High Radiation Area
⊕	- Contact Dose Rate	VR	- Very High Radiation Area
⊗	- 30 cm Dose Rate	AR	- Airborne Radioactivity Area
⊙	- General Area Dose Rate	RM	- Radioactive Materials Area
⊖	- Step-off Pad	UM	- Underground Radioactive Materials Area
⊙	- Air Sample Location	BA	- Radiological Buffer Area
		CA	- Contamination Area
		HC	- High Contamination Area
		FC	- Fixed Contamination Area
		SC	- Soil Contamination Area

Default units are in mR/hr and are for open window beta/gamma readings. Letter suffixes with the number indicate specific radiations: B - Beta (mRad/hr), G - Gamma (mR/hr), N - Neutron (mRem/hr). Boundary designations are looking from the designations into the zoned area.

ORNL Radiological Survey Data

Survey Number: 3038-94-0047 3038 Field Office Date: 9/15/94 Time: 09:00

Surveyor Badge Number: 32721 Routine Survey RWP Number: 102130

Building: 3030 Specific Location: Hoods

Description:
Final smear results before deconners paint the strippable coating in all three hoods.

Instruments Used and Calibration Due Date:
CTB-047 2/23/95

General Description of Radiological Conditions:
See attached maps for the final smear results. The hoods were painted today with the yellow strippable coating.

Division or Group Needing the Survey: CT Person-hours spent on the survey: 0

of Pages: 4 Completed By: Janet Cox Reviewed by: Alister Date: 9-19-94

ORNL Radiological Survey Data

Survey Number: ORNL-94-0027
 ORNL-94-0031

3038 Field Office


Date: 9/9/94 Time: 1440

Give only DM on smear over	
β	β
N/A	dpm/100 cm ² @
200	dpm/100 cm ² @
1	34
2	35
3	36
4	37
5	38
6	39
7	40
8	41
9	42
10	43
11	44
12	45
13	46
14	47
15	48
16	49
17	50
18	51
19	52
20	53
21	54
22	55
23	56
24	57
25	58
26	59
27	60
28	61
29	62
30	63
31	64
32	65
33	66

3030

Hood # 1

Counter: CTB-047
 cal. due: 2/95

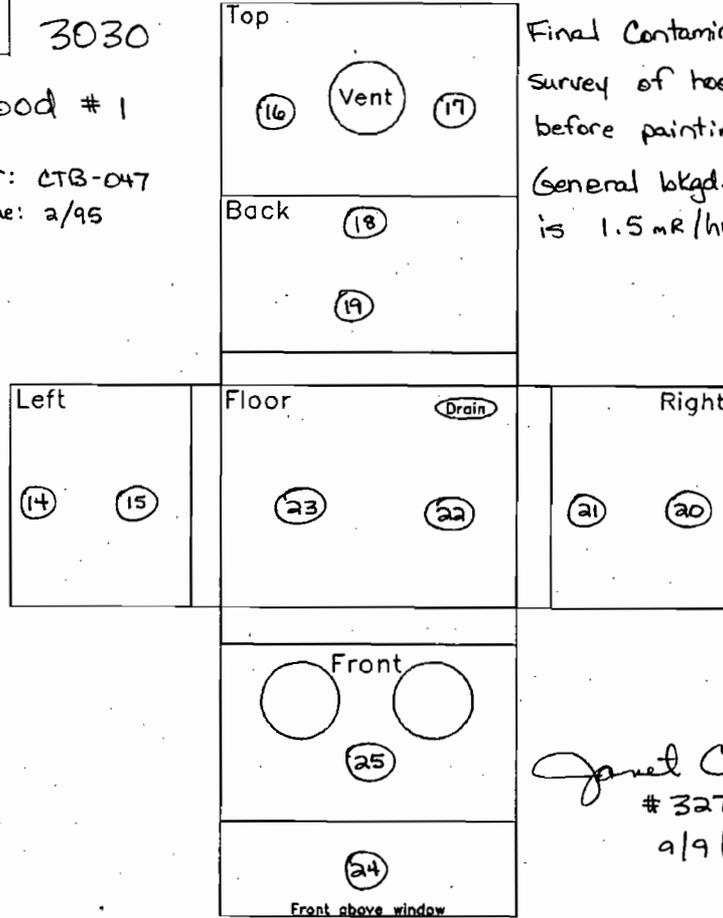

Final Contamination Survey of hood before painting. General bkgd. in hood is 1.5 mR/hr.

Janet Cox
 # 32721
 9/9/94

Legend		Boundary Designations	
⊙	- Smear Location	RA - Radiation Area	BA - Radiological Buffer Area
⊕	- Large Area Smear	HR - High Radiation Area	CA - Contamination Area
#	- Contact Dose Rate	VR - Very High Radiation Area	HC - High Contamination Area
#	- 30 cm Dose Rate	AR - Airborne Radioactivity Area	FC - Fixed Contamination Area
#	- General Area Dose Rate	RM - Radioactive Materials Area	SC - Soil Contamination Area
[SOP]	- Step-off Pad	UM - Underground Radioactive Materials Area	
AS	- Air Sample Location		

Default units are in mR/hr and are for open window beta/gamma readings. Letter suffixes with the number indicate specific radiations: B - Beta (mRad/hr), G - Gamma (mR/hr), N - Neutron (mRem/hr). Boundary designations are looking from the designations into the zoned area.

ORNL Radiological Survey Data

Survey Number: 3038-94-0046

3038 Field Office


Date: 9/14/94 Time: 1345

Give only DM as shown over	
<u>N/A</u>	dpm/100 cm ² @
<u>200</u>	dpm/100 cm ² @
B	B
1	280 34
2	784 35
3	910 36
4	5943 37
5	819 38
6	245 39
7	3871 40
8	2240 41
9	1841 42
10	371 43
11	609 44
12	1820 45
13	399 46
14	210 47
15	
16	
17	
18	
19	
20	
21	
22	
23	
24	
25	
26	
27	
28	
29	
30	
31	
32	
33	
34	
35	
36	

3030

Hood # 2

Counter: CTB-047
Cal. due: 2/95

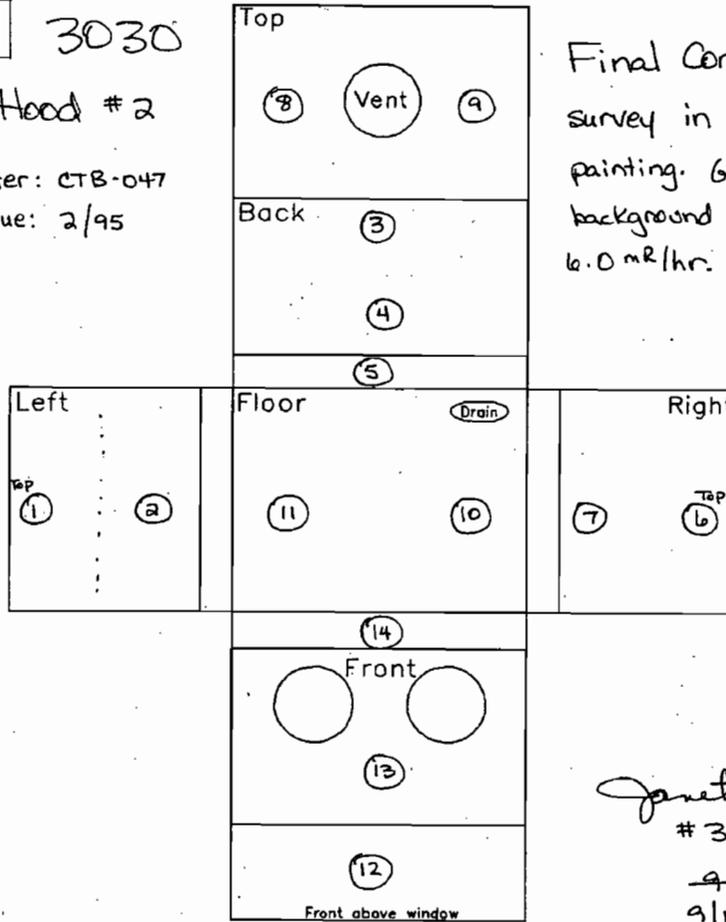

Final Contamination survey in hood before painting. General background in hood is 6.0 mR/hr.

Janet Cox
32721
9/12/94
9/14/94

Legend		Boundary Designations	
⊙	- Smear Location	RA - Radiation Area	BA - Radiological Buffer Area
⊗	- Large Area Smear	HR - High Radiation Area	CA - Contamination Area
#	- Contact Dose Rate	VR - Very High Radiation Area	HC - High Contamination Area
#	- 30 cm Dose Rate	AR - Airborne Radioactivity Area	FC - Fixed Contamination Area
#	- General Area Dose Rate	RM - Radioactive Materials Area	SC - Soil Contamination Area
SOP	- Step-off Pad	UM - Underground Radioactive Materials Area	
AS	- Air Sample Location		

Default units are in mR/hr and are for open window beta/gamma readings. Letter suffixes with the number indicate specific radiations: B - Beta (mRad/hr), G - Gamma (mR/hr), N - Neutron (mRem/hr). Boundary designations are looking from the designations into the zoned area.

ORNL Radiological Survey Data

Survey Number: ⁸³⁰³⁸ ORNL-94-0027 3038 Field Office Date: 9/9/94 Time: 1440
~~ORNL-94-0031~~


Give only D/M or mean over	
N/A	dpm/100 cm ² @
200	dpm/100 cm ² @
B	B
1	<200 34
2	<200 35
3	392 36
4	868 37
5	315 38
6	456 39
7	805 40
8	385 41
9	1134 42
10	<200 43
11	<200 44
12	651 45
13	371 46
14	
15	
16	
17	
18	
19	
20	
21	
22	
23	
24	
25	
26	
27	
28	
29	
30	
31	
32	
33	

3030

Hood # 3

Counter: CTB-047
 cal. due: 2/95

#(4) was a re-smear of spot. See file 3038-94-0027

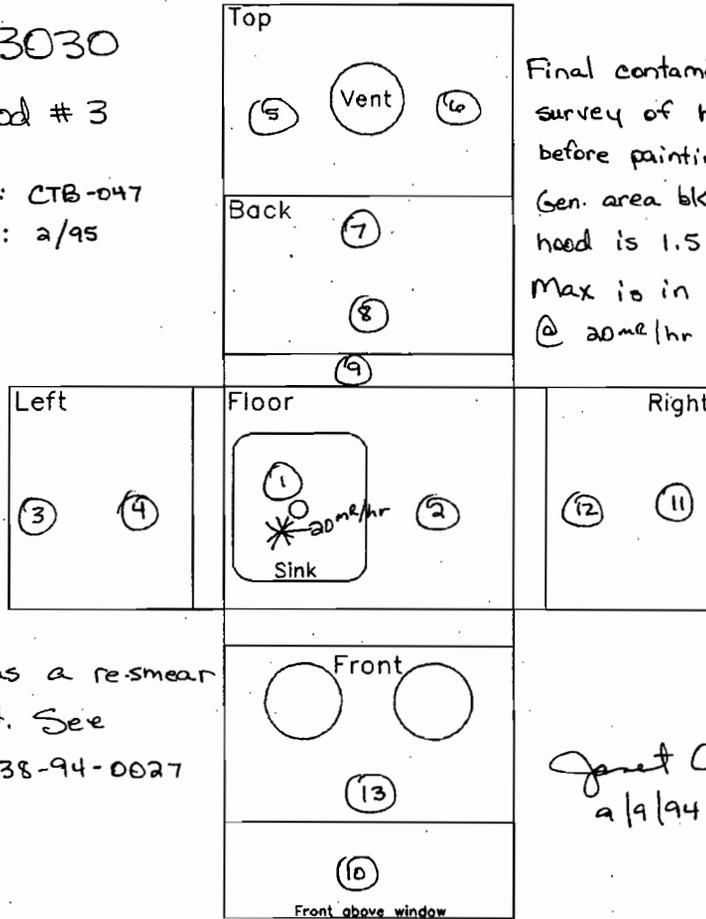

Final contamination survey of hood before painting. Gen. area bkgd. in hood is 1.5 mR/hr. Max is in sink @ 20 mR/hr

Janet Cox #32721
 9/9/94

Boundary Designations	
(#) - Smear Location	RA - Radiation Area
(#)-(#) - Large Area Smear	BA - Radiological Buffer Area
# - Contact Dose Rate	CA - Contamination Area
# - 30 cm Dose Rate	VR - Very High Radiation Area
# - General Area Dose Rate	HC - High Contamination Area
[SOP] - Step-off Pad	AR - Airborne Radioactivity Area
AS - Air Sample Location	FC - Fixed Contamination Area
	RM - Radioactive Materials Area
	SC - Soil Contamination Area
	UM - Underground Radioactive Materials Area

Default units are in mR/hr and are for open window beta/gamma readings. Letter suffixes with the number indicate specific radiations: B - Beta (mRad/hr), G - Gamma (mR/hr), N - Neutron (mRem/hr). Boundary designations are looking from the designations into the zoned area.

ORNL Radiological Survey Data

Survey Number: 3038-96-1743

3038 Field Office

Date: 8/16/96

10:10
Time: 14:58

Surveyor Badge Number: 626079

Routine Survey

RWP Number: N/A

Building: 3030

Specific Location: Roof

Description:

Bi-annual radiation survey.

Instruments Used and Calibration Due Date:

3038-41 11/25/96

General Description of Radiological Conditions:

The average whole body dose is ~ 0.24 mR/hr beta-gamma. The highest background reading was 0.8 mR/hr on the northeast side near building 3029. The filter bank read about the same as the background.

Division or Group Needing the Survey: CT

Person-hours spent on the survey: 1

of Pages: 2

Completed By: *D. Hank Lawson*

Reviewed by: *J. Slats*

Date: 8-20-96

ORNL Radiological Survey Data

626079

Survey Number: 3038-96-1743

3038 Field Office


Date: 8-15-96 Time: 1010

3038-41

Give only D/M on sheets over
 dpm/100 cm² s
 dpm/100 cm² s

a	β
1	1
2	2
3	3
4	4
5	5
6	6
7	7
8	8
9	9
10	10
11	11
12	12
13	13
14	14
15	15
16	16
17	17
18	18
19	19
20	20
21	21
22	22
23	23
24	24
25	25
26	26
27	27
28	28
29	29
30	30
31	31
32	32
33	33



3030 Roof

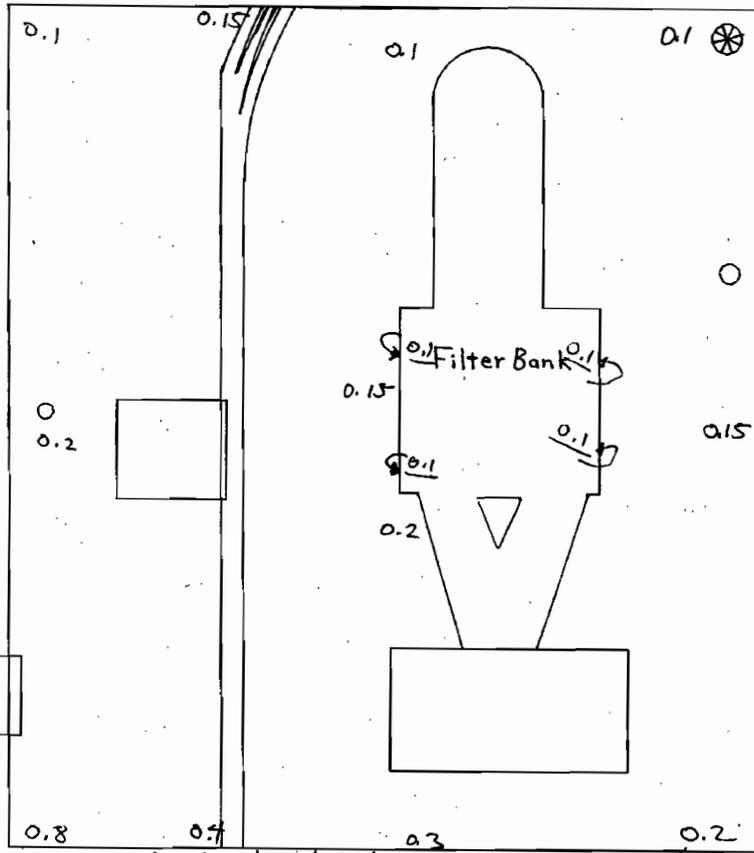

Average whole body dose \approx 0.24 mR/hr Bx

		Boundary Designations	
(#)	- Smear Location	RA - Radiation Area	BA - Radiological Buffer Area
(#)	- Large Area Smear	HR - High Radiation Area	CA - Contamination Area
#	- Contact Dose Rate	VR - Very High Radiation Area	HC - High Contamination Area
#	- 30 cm Dose Rate	AR - Airborne Radioactivity Area	FC - Fixed Contamination Area
#	- General Area Dose Rate	RM - Radioactive Materials Area	SC - Soil Contamination Area
[SOP]	- Step-off Pad	UM - Underground Radioactive Materials Area	
AS	- Air Sample Location		

Default units are in mR/hr and are for open window beta/gamma readings. Letter suffixes with the number indicate specific radiations: B - Beta (mRad/hr), G - Gamma (mR/hr), N - Neutron (mRem/hr). Boundary designations are looking from the designations into the zoned area.

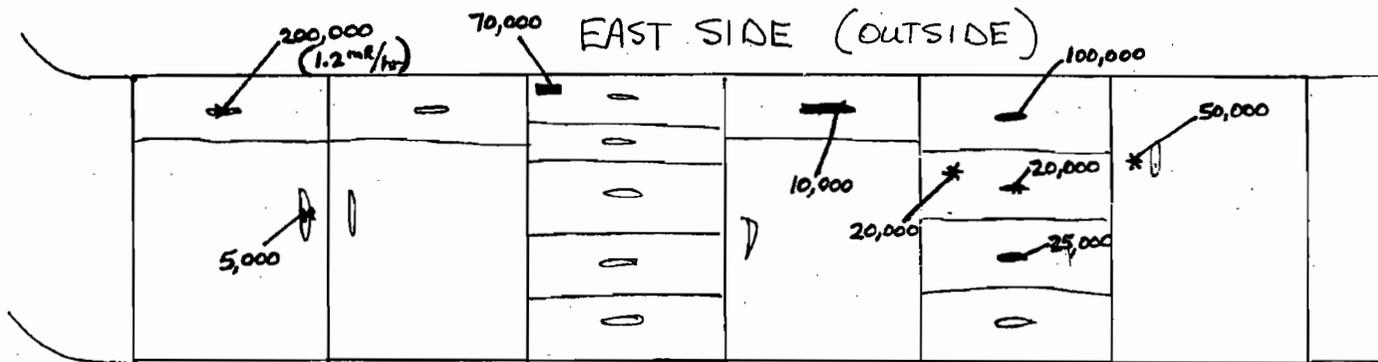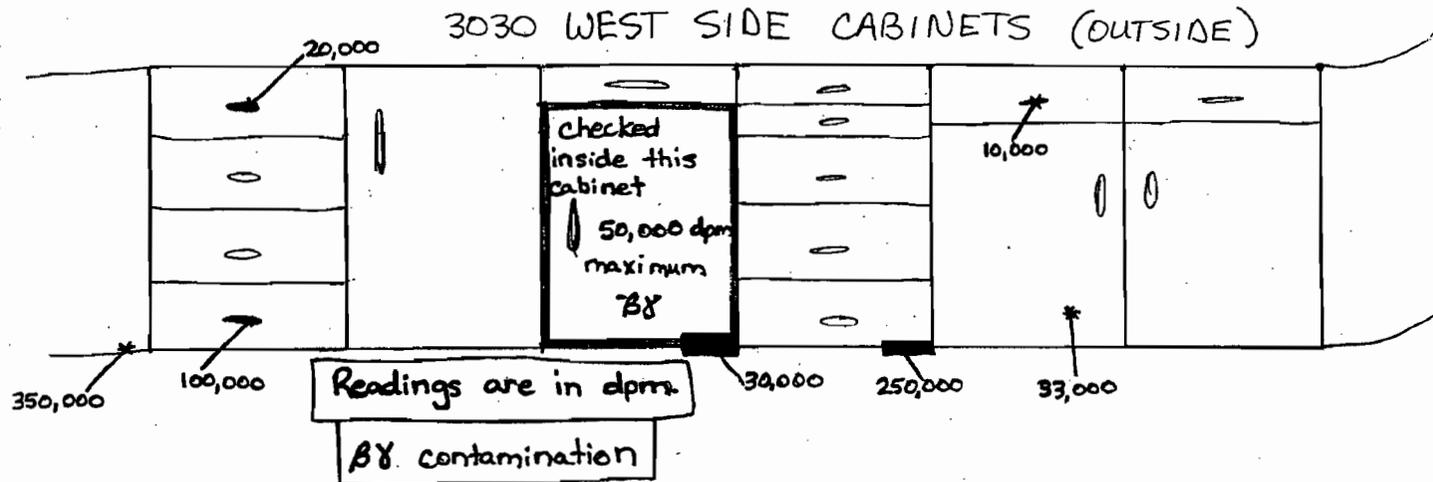

Janet Cox 4/5/92
3038-3P

ORNL Radiological Survey Data

Survey Number: 3038-95-1285

3038 Field Office

Date: 12/4/95 Time: 0800

3030


Give only D/M on smear over

NA	4pm/100 cm ² @
48	4pm/100 cm ² @

B	B
1	34
2	35
3	36
4	37
5	38
6	39
7	40
8	41
9	42
10	43
11	44
12	45
13	46
14	47
15	48
16	49
17	50
18	51
19	52
20	53
21	54
22	55
23	56
24	57
25	58
26	59
27	60
28	61
29	62
30	63
31	64
32	65
33	66

26 /MDA 59 NC
 27 /MDA 60 NC
 28 /MDA 61 NC
 29 150 62 NC

CTB-047
 3038-10P
 John
 Burnett
 740165
 continuing
 survey

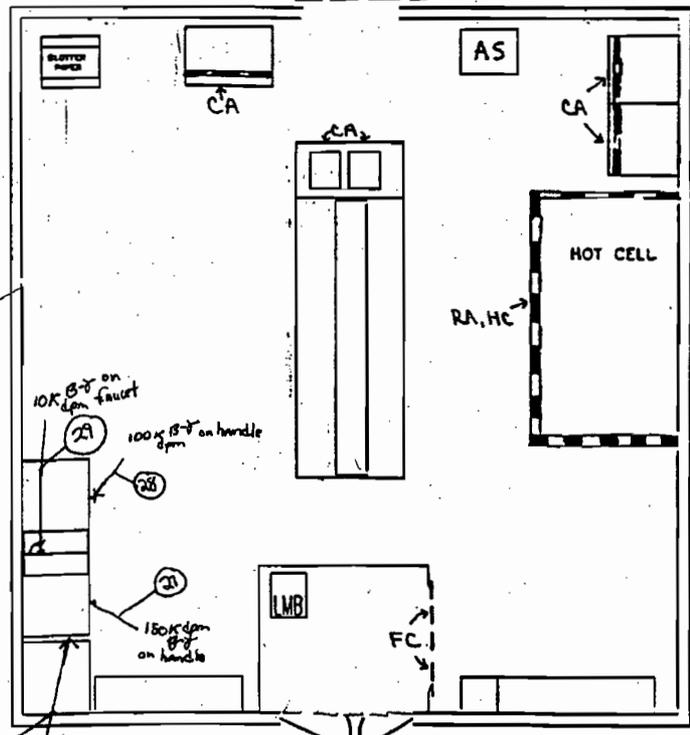

Smear Location		Boundary Designations	
①	- Smear Location	RA	- Radiation Area
②	- Large Area Smear	BA	- Radiological Buffer Area
#	- Contact Dose Rate	HR	- High Radiation Area
#	- 30 cm Dose Rate	VR	- Very High Radiation Area
#	- General Area Dose Rate	AR	- Airborne Radioactivity Area
SOP	- Step-off Pad	FC	- Fixed Contamination Area
AS	- Air Sample Location	RM	- Radioactive Materials Area
		UM	- Underground Radioactive Materials Area

Default units are in mR/hr and are for open window beta/gamma readings. Letter suffixes with the number indicate specific radiations: B - Beta (mRad/hr), G - Gamma (mR/hr), N - Neutron (mRem/hr). Boundary designations are looking from the designations into the zoned area.

Duloran Crosson
626079

ORNL Radiological Survey Data


Survey Number: 3038-96-1362 3038 Field Office Date: 1-12-96 Time: 1500

3038-6P
CTB-047

3030

Give daily DPM on smear over
20 dpm/100 cm² &
200 dpm/100 cm² &

B	B
1	34
2	35
3	36
4	37
5	38
6	39
7	40
8	41
9	42
10	43
11	44
12	45
13	46
14	47
15	48
16	49
17	50
18	51
19	52
20	53
21	54
22	55
23	56
24	57
25	58
26	59
27	60
28	61
29	62
30	63
31	64
32	65
33	66

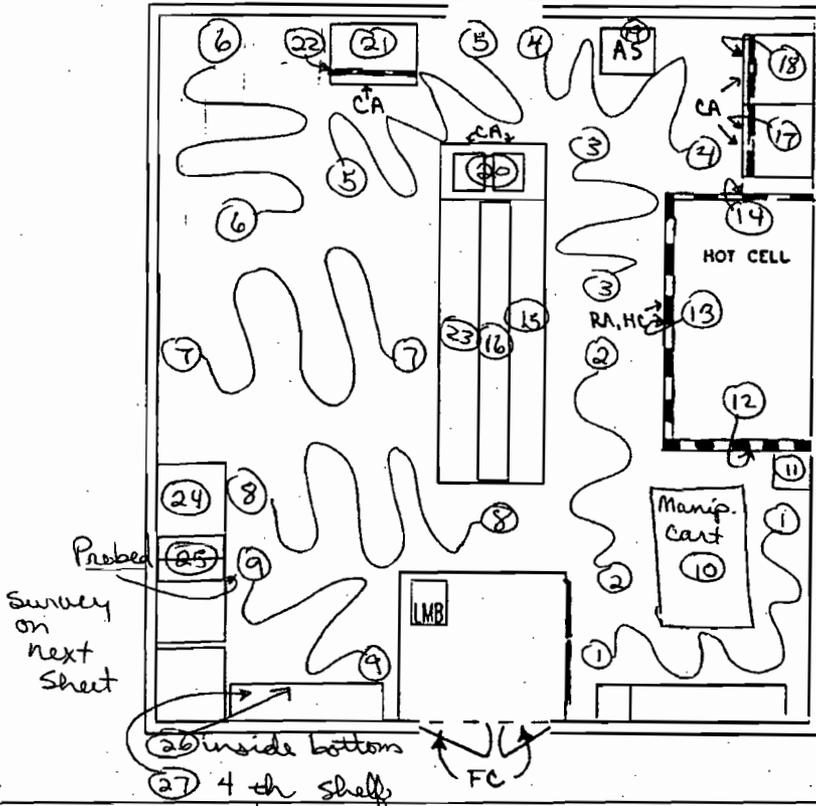

Smear Location		Boundary Designations	
①-②	- Large Area Smear	RA	- Radiation Area
#	- Contact Dose Rate	BA	- Radiological Buffer Area
#	- 30 cm Dose Rate	CA	- Contamination Area
#	- General Area Dose Rate	HR	- High Radiation Area
[SOP]	- Step-off Pad	VR	- Very High Radiation Area
AS	- Air Sample Location	AR	- Airborne Radioactivity Area
		RM	- Radioactive Materials Area
		UM	- Underground Radioactive Materials Area
		HC	- High Contamination Area
		FC	- Fixed Contamination Area
		SC	- Soil Contamination Area

Default units are in mR/hr and are for open window beta/gamma readings. Letter suffixes with the number indicate specific radiations: B - Beta (mRad/hr), G - Gamma (mR/hr), N - Neutron (mRem/hr). Boundary designations are looking from the designations into the zoned area.

ORNL Radiological Survey Data

Survey Number: 3038-96-1362


3038 Field Office

Date: 1-10-96 Time: 1300

3030 Sink + cabinets
in Southwest corner

3038-7P+4B
CTB-047

See first map

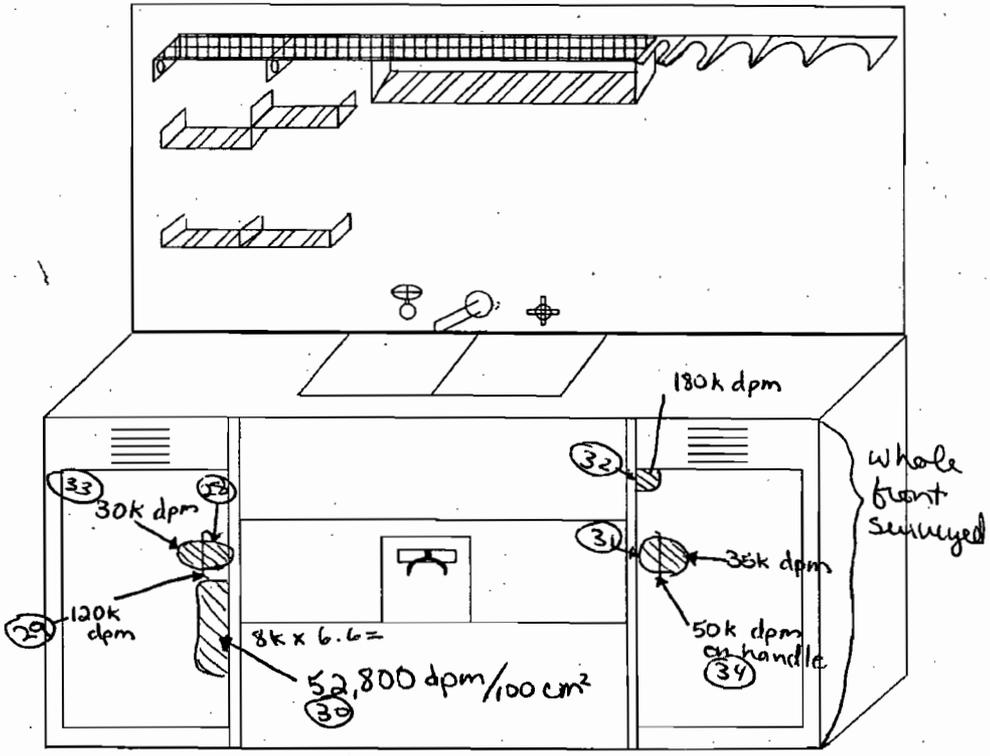

Background from 4k to 3k on this side

Readings are beta-gamma these areas probed < 500 dpm/100 cm² or

Legend		Boundary Designations	
①	- Smear Location	RA - Radiation Area	BA - Radiological Buffer Area
②	- Large Area Smear	NR - High Radiation Area	CA - Contamination Area
③	- Contact Dose Rate	VR - Very High Radiation Area	HC - High Contamination Area
④	- 30 cm Dose Rate	AR - Airborne Radioactivity Area	FC - Fixed Contamination Area
⑤	- General Area Dose Rate	RM - Radioactive Materials Area	SC - Soil Contamination Area
⑥	- Step-off Pad	UM - Underground Radioactive Materials Area	
⑦	- Air Sample Location		

Default units are in mR/hr and are for open window beta/gamma readings. Letter suffixes with the number indicate specific radiations: B - Beta (mRad/hr), G - Gamma (mR/hr), N - Neutron (mRem/hr). Boundary designations are looking from the designations into the zoned area.

ORNL Radiological Survey Data

Survey Number: 3038-96-1862

3038 Field Office

Date: 1-16-96


Time: 1300

3038-7P+4B

CTB-047

1	B
2	See first sheet
3	
4	
5	
6	
7	
8	
9	
10	
11	
12	
13	
14	
15	
16	
17	
18	
19	
20	
21	
22	
23	
24	
25	
26	
27	
28	
29	
30	
31	
32	
33	
34	
35	
36	
37	
38	
39	
40	
41	
42	
43	
44	
45	
46	
47	
48	
49	
50	
51	
52	
53	
54	
55	
56	
57	
58	
59	
60	

3030 cabinets
under sink
inside view

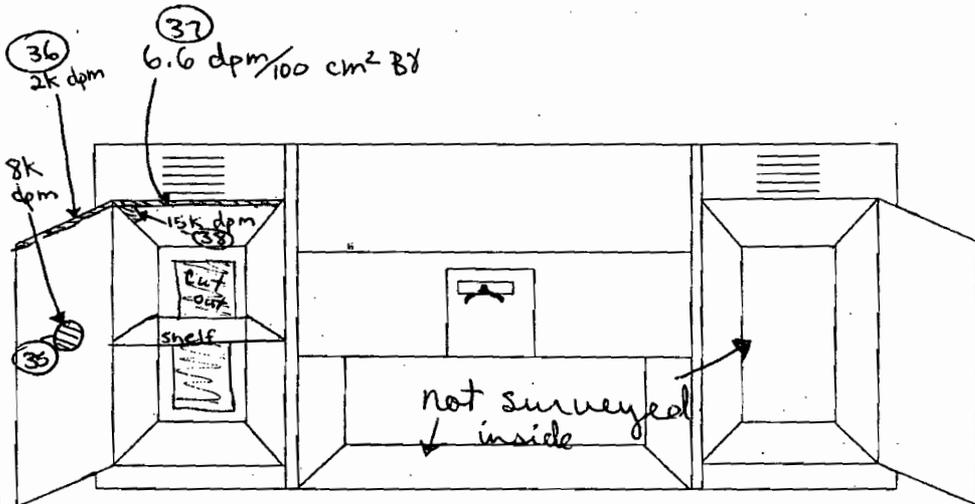

Background 4k to 3k

Readings are beta-gamma, these areas probed < 500 dpm/100 cm² α

Legend		Boundary Designations	
⊙	- Smear Location	RA - Radiation Area	BA - Radiological Buffer Area
⊙-⊙	- Large Area Smear	HR - High Radiation Area	CA - Contamination Area
⊖	- Contact Dose Rate	VR - Very High Radiation Area	HC - High Contamination Area
⊖	- 30 cm Dose Rate	AR - Airborne Radioactivity Area	FC - Fixed Contamination Area
⊖	- General Area Dose Rate	RM - Radioactive Materials Area	SC - Soil Contamination Area
⊖	- Step-off Pad	UM - Underground Radioactive Materials Area	
AS	- Air Sample Location		

Default units are in mR/hr and are for open window beta/gamma readings. Letter suffixes with the number indicate specific radiation: B - Beta (mRad/hr), G - Gamma (mR/hr), N - Neutron (mRem/hr). Boundary designations are looking from the designations into the zoned area.

Low level smears
626079

ORNL Radiological Survey Data

Survey Number: 3038-96-1402

3038 Field Office


Date: 2-12-96 Time: 1330

3038-7P+5B+1I
CTB-047
CTA-041

3030

Give only DM on smears over
20 dpm/100 cm² &
200 dpm/100 cm² &

B	B
1	34
2	35
3	36
4	37
5	38
6	39
7	40
8	41
9	42
10	43
11	44
12	45
13	46
14	47
15	48
16	49
17	50
18	51
19	52
20	53
21	54
22	55
23	56
24	57
25	58
26	59
27	60
28	61
29	62
30	63
31	64
32	65
33	66

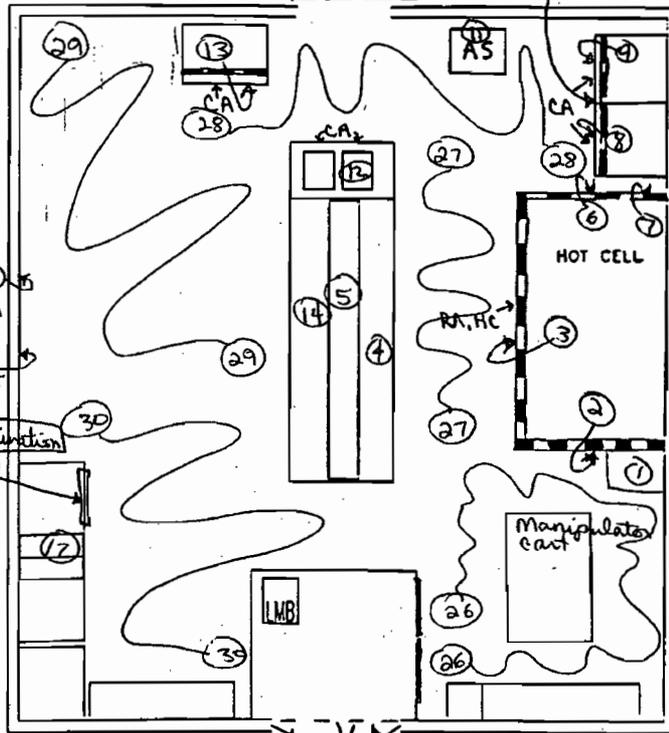

Boundary Designations	
① - Smear Location	RA - Radiation Area
② - Large Area Smear	BA - Radiological Buffer Area
# - Contact Dose Rate	HR - High Radiation Area
# - 30 cm Dose Rate	CA - Contamination Area
# - General Area Dose Rate	VR - Very High Radiation Area
[SOP] - Step-off Pad	HC - High Contamination Area
AS - Air Sample Location	FC - Fixed Contamination Area
	RM - Radioactive Materials Area
	SC - Soil Contamination Area
	UM - Underground Radioactive Materials Area

Default units are in mR/hr and are for open window beta/gamma readings. Letter suffixes with the number indicate specific radiations: B - Beta (mRad/hr), G - Gamma (mR/hr), N - Neutron (mRem/hr). Boundary designations are looking from the designations into the zoned area.

Wesley L. Vossano
626079

ORNL Radiological Survey Data


Survey Number: 3038-96

3038 Field Office

Date: 2-12-96 Time: 1330

α	β
1	
2	
3	
4	
5	
6	
7	
8	
9	
10	
11	
12	
13	
14	
15	
16	
17	
18	
19	
20	
21	
22	
23	
24	
25	
26	
27	
28	
29	
30	
31	
32	
33	
34	
35	
36	
37	
38	
39	
40	
41	
42	
43	
44	
45	
46	
47	
48	
49	
50	
51	

The rest of the inside of this cabinet probed < 1000 dpm/100cm Bγ + < 500 α

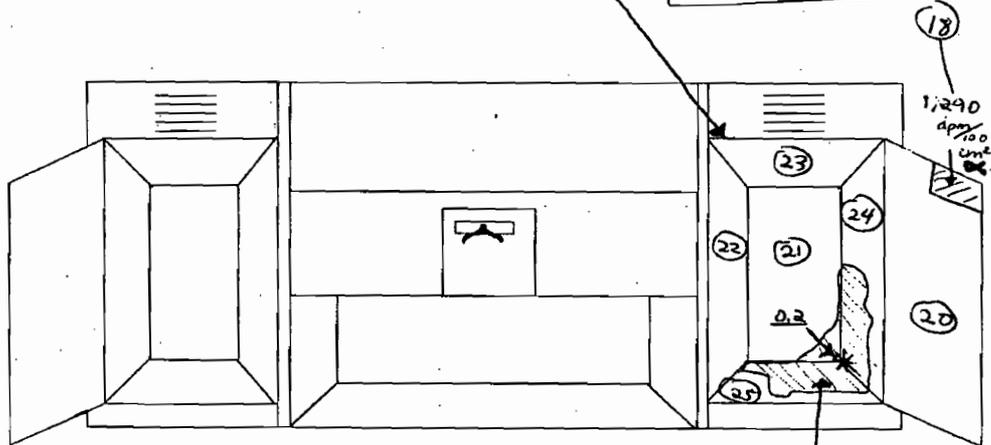

up to $\frac{150K \times 6.6}{100} = 990,000 \text{ dpm/100cm}^2 \text{ B}\gamma$

Background 4k to 5k dpm Bγ

Boundary Designations	
Ⓢ - Smear Location	BA - Radiological Buffer Area
Ⓢ - Large Area Smear	CA - Contamination Area
Ⓢ - Contact Dose Rate	HC - High Contamination Area
Ⓢ - 30 cm Dose Rate	FC - Fixed Contamination Area
Ⓢ - General Area Dose Rate	SC - Soil Contamination Area
Ⓢ (SOP) - Step-off Pad	UM - Underground Radioactive Materials Area
AS - Air Sample Location	
RA - Radiation Area	
HR - High Radiation Area	
VR - Very High Radiation Area	
AR - Airborne Radioactivity Area	
RM - Radioactive Materials Area	

Default units are in mR/hr and are for open window beta/gamma readings. Letter suffixes with the number indicate specific radiations: B - Beta (mRad/hr), G - Gamma (mR/hr), N - Neutron (mRem/hr). Boundary designations are looking from the designations into the zoned area.

3

ORNL Radiological Survey Data

Survey Number: 3038-96-1584 3038 Field Office Date: 5-15-96 Time: 11:00


Give only D/M on sheets over
 dpm/100 cm² s
 dpm/100 cm² s

B	B
1	24
2	25
3	26
4	27
5	28
6	29
7	30
8	31
9	32
10	33
11	34
12	35
13	36
14	37
15	38
16	39
17	40
18	41
19	42
20	43
21	44
22	45
23	46
24	47
25	48
26	49
27	50
28	51
29	52
30	53
31	54
32	55
33	56
34	57
35	58
36	59
37	60
38	61
39	62
40	63
41	64
42	65
43	66

3038-03P
 3038-10B

3030

Colman

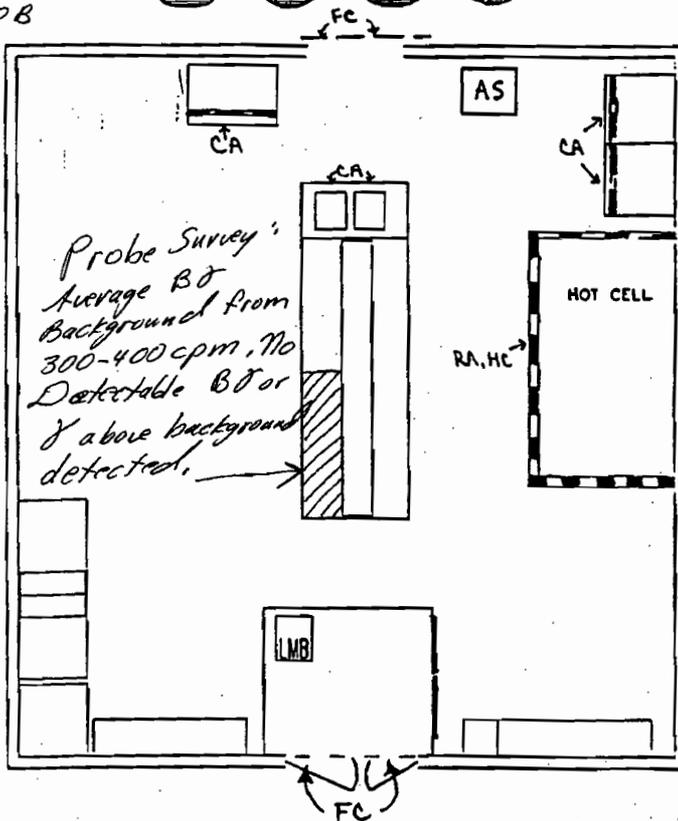

Smear Location		Boundary Designations	
①	- Large Area Smear	RA - Radiation Area	BA - Radiological Buffer Area
②	- Contact Dose Rate	HR - High Radiation Area	CA - Contamination Area
③	- 30 cm Dose Rate	VR - Very High Radiation Area	HC - High Contamination Area
④	- General Area Dose Rate	AR - Airborne Radioactivity Area	FC - Fixed Contamination Area
⑤	- Step-off Pad	RM - Radioactive Materials Area	SC - Soil Contamination Area
⑥	- Air Sample Location	UM - Underground Radioactive Materials Area	

Default units are in mR/hr and are for open window beta/gamma readings. Letter suffixes with the number indicate specific radiations: B - Beta (mRad/hr), G - Gamma (mR/hr), N - Neutron (mRem/hr). Boundary designations are looking from the designations into the zoned area.

Leveaux Crossed
626079

ORNL Radiological Survey Data


Survey Number: 3038-97-0155 3038 Field Office Date: 2-26-77 Time: 1500

Latest contamination survey CTB-047 3038-8P

3030

Give only DM on smears over
20 dpa/100 cm² s
200 dpa/100 cm² s

B	B
1	34
2	35
3	36
4	37
5	38
6	39
7	40
8	41
9	42
10	43
11	44
12	45
13	ND/GMT
14	47
15	48
16	49
17	50
18	51
19	52
20	53
21	54
22	55
23	56
24	57
25	58
26	59
27	60
28	61
29	62
30	63
31	64
32	65
33	66

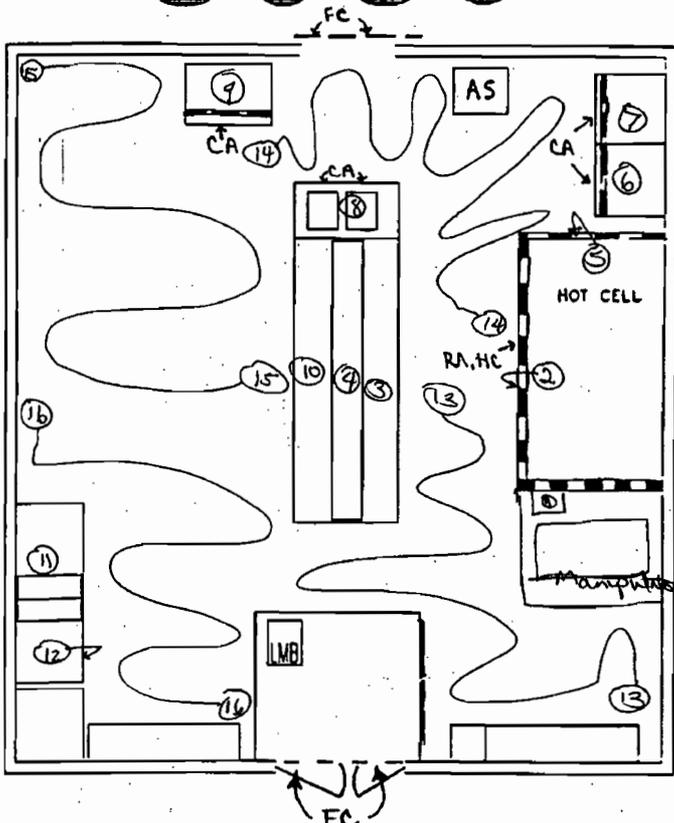

#	- Smear Location	Boundary Designations	
①-②	- Large Area Smear	RA - Radiation Area	BA - Radiological Buffer Area
#	- Contact Dose Rate	HR - High Radiation Area	CA - Contamination Area
#	- 30 cm Dose Rate	VR - Very High Radiation Area	HC - High Contamination Area
#	- General Area Dose Rate	AR - Airborne Radioactivity Area	FC - Fixed Contamination Area
[SOP]	- Step-off Pad	RM - Radioactive Materials Area	SC - Soil Contamination Area
AS	- Air Sample Location	UM - Underground Radioactive Materials Area	

Default units are in mR/hr and are for open window beta/gamma readings. Letter suffixes with the number indicate specific radiations: B - Beta (mRad/hr), G - Gamma (mR/hr), N - Neutron (mRem/hr). Boundary designations are looking from the designations into the zoned area.

**ATTACHMENT 8
S&M TURNOVER
PACKAGE CHECKLIST**

S&M Turnover Package Checklist

Item Number	Document	Applicable ?
1	Postdeactivation Surveillance and Maintenance Plan	Yes
2	Postdeactivation Surveillance and Maintenance Updated Effluent Monitoring Plan	No
3	Postdeactivation Surveillance and Maintenance Updated Safety Equipment List	Yes
4	Postdeactivation Surveillance and Maintenance Procedures	Yes
5	Postdeactivation Surveillance and Maintenance Recommendations	No
6	Mothballed Systems Lay-up and Restart Documentation	No

DISTRIBUTION

1. L. V. Asplund
2. W. D. Brickeen
3. R. A. Brown
4. T. W. Burwinkle
5. K. Constant
- 6-15. R. E. Eversole
17. K. W. Haff
18. S. A. Herron
19. L. L. Kaiser
20. T. M. Koepp
21. P. T. Owen
22. L. D. Owens
23. B. D. Patton
24. L. B. Raulston
25. Central Research Library
26. File—EMEF DMC—RC

